Air Conditioning

Technical Data

VRVIII-S heat pump

EEDEN12-200

RXYSQ-P8Y1

TABLE OF CONTENTS

RXYSQ-P8Y1

1 Features 2

2 Specifications 3
Technical Specifications 3
Electrical Specifications 4

3 Options 6
Options 6

4 Capacity tables 7
Capacity Table Legend 7
Cooling Capacity Tables 8
Heating Capacity Tables 14
Integrated Heating Capacity Correction Factor 20
Capacity Correction Factor 21

5 Dimensional drawings 24
Dimensional Drawings 24

6 Centre of gravity 25
Centre of Gravity 25

7 Piping diagrams 26
Piping Diagrams 26

8 Wiring diagrams 27
Wiring Diagrams - Single Phase 27

9 External connection diagrams 28
External Connection Diagrams 28

10 Sound data 29
Sound Power Spectrum 29
Sound Pressure Spectrum 30

11 Installation 32
Service Space 32
Refrigerant Pipe Selection 33

12 Operation range 35
Operation Range 35

1 Features

- For residential and light commercial applications
- Energy efficient heating system based on air source heat pump technology
- Low energy bills and low CO2 emissions
- Possibility to connect up to 9 indoor units
- All indoor units can be individually controlled and do not need to be installed in the same room or even at the same time.
- Wide range of indoor units: either connect VRV® or stylish indoor units such as Daikin Emura, Nexura ...
- Possibility to combine different types of indoor units: wall mounted, floor standing, concealed ceiling, ceiling suspended, round flow or 4-way blow cassettes
- Small capacities: 4, 5 & 6HP
- Slim design for flexible installation
- 3 steps in night quiet mode: step 1: 47dBA, step 2: 44 dBA, step 3: 41 dBA
- Easy installation thanks to automatic refrigerant charging operation, automatic test operation
- Possibility to limit peak power consumption between 30 and 80%, for example during periods with high power demand

INVERTER

2 Specifications

2-1 Technical Specifications					RXYSQ4P8Y1	RXYSQ5P8Y1	RXYSQ6P8Y1
Capacity range				HP	4	5	6
Cooling capacity	Nom.			kW	12.6 (1)	14.0 (1)	15.5 (1)
Heating capacity	Nom.			kW	14.2 (2)	16.0 (2)	18.0 (2)
Capacity control	Method				Inverter controlled		
	Steps			%	24 ~ 100		
Power input - 50Hz	Cooling	Nom.		kW	3.33	3.61	4.66
	Heating	Nom.		kW	3.21	3.97	4.70
EER					3.78	3.88	3.33
COP					4.42	4.03	3.83
Maximum number of connectable indoor units					8 (6) / 8 (7)	10 (6) / 9 (7)	12 (6) / 9 (7)
Indoor index connection	Min.				50	62.5	70
	Nom.				-		
	Max.				130	162.5	182
Casing	Colour				Daikin White		
	Material				Painted galvanized steel plate		
Dimensions	Unit	Height		mm	1,345		
		Width		mm	900		
		Depth		mm	320		
	Packed unit	Height		mm	1,524		
		Width		mm	980		
		Depth		mm	420		
Weight	Unit			kg	120		
	Packed unit			kg	130		
Packing	Material				Carton / Wood / EPS	Carton / Wood / EPS	Carton / Wood / EPS
	Weight			kg	8		
Heat exchanger	Length			mm	857		
	Rows	Quantity			2		
	Fin pitch			mm	2		
	Passes	Quantity			10		
	Face area			m^2	1.131		
	Stages	Quantity			60		
	Empty tubeplate hole	Quantity			0		
	Tube type				ø8 Hi-XSS		
	Fin	Type			Non-symmetric waffle louvre		
		Treatment			Corrosion resistant		
Fan	Type				Propeller fan		
	Quantity				2		
	Air flow rate	Cooling	Nom.	m^3/min	106		
		Heating	Nom.	m^3/min	102	105	
	External static pressure	Max.		Pa	-		
	Discharge direction				Horizontal		
Fan motor	Quantity				2		
	Model				Brushless DC motor		
	Speed	Cooling	Nom.	rpm	850		
		Heating	Nom.	rpm	820	840	
	Drive				Direct drive		
	Output			W	70		
Fan motor 2	Model				Brushless DC motor		
	Speed	Cooling	Nom.	rpm	815		
		Heating	Nom.	rpm	785	805	
	Drive				Direct drive		
	Output			W	70		
Sound power level	Cooling	Nom.		dBA	66	67	69
Sound pressure level	Cooling	Nom.		dBA	50	51	53
	Heating	Nom.		dBA	52	53	55

2 Specifications

2-1 Technical Specifications					RXYSQ4P8Y1	RXYSQ5P8Y1	RXYSQ6P8Y1
Compressor	Quantity				1		
	Model				JT1G-VDLYR		
	Type				Hermetically sealed scroll compressor		
	Speed			rpm	6,480		
	Output			W	2,500	3,000	3,500
	Starting method				Direct on line		
	Crankcase heater			W	33		
Operation range	Cooling	Min.~Max.		°CDB	-5~46		
	Heating	Min.~Max.		°CWB	-20~15.5		
Refrigerant	Type				R-410A		
	Charge			kg	4.0		
	Control				Expansion valve		
	Circuits	Quantity			1		
Refrigerant oil	Type				Daphne FVC68D		
	Charged volume			l	1.5		
Piping connections	Liquid	Type			Flare connection		
		OD		mm	9.52		
	Gas	Type			Flare connection (VRV®) / Braze connection (RA)	Flare connection (VRV®) / Braze connection (RA)	Braze connection
		OD		mm	15.9 (6) / 19.1 (7)	15.9 (6) / 19.1 (7)	19.1
	Drain	Quantity			3		
		OD		mm	26x3		
	Heat insulation				Both liquid and gas pipes		
	Piping length	OU - BP	Total	m	55 (7)		
		BP - IU	Max.	m	15 (7)		
			Total	m	60 (7)	80 (7)	90 (7)
	Total piping length	System	Actual	m	300 (6) / 115 (7)	300 (6) / 135 (7)	300 (6) / 145 (7)
	Level difference	OU - IU	Outdoor unit in highest position	m	-		
			Indoor unit in highest position	m	-		
Defrost method					Reversed cycle		
Defrost control					Sensor for outdoor heat exchanger temperature		
Safety devices	Item	01			HPS		
		02			Fan motor thermal protection		
		03			Inverter overload protector		
		04			PC board fuse		
PED	Category				Category I		

Standard Accessories : Connection pipes; Quantity : 3;

Standard Accessories : Operation manual; Quantity : 1;

Standard Accessories : Installation manual; Quantity : 1;

2-2 Electrical Specifications				RXYSQ4P8Y1	RXYSQ5P8Y1	RXYSQ6P8Y1
Power supply	Name			Y1		
	Phase			3N~		
	Frequency		Hz	50		
	Voltage		V	380-415		
Voltage range	Min.		%	-10		
	Max.		%	10		
Current	Nominal running current (RLA) - 50Hz	Cooling	A	5.30	6.77	7.79

2 Specifications

2-2 Electrical Specifications				RXYSQ4P8Y1	RXYSQ5P8Y1	RXYSQ6P8Y1
Current - 50Hz	Maximum running current		A	13.5		
	Starting current (MSC)		A	5.30	6.77	7.79
	Zmax	List		No requirements		
	Minimum circuit amps (MCA)		A	13.5		
	Maximum fuse amps (MFA)		A	16.0		
	Full load amps (FLA)	Fan motor	A	0.3		
		Fan motor 2	A	0.3		
Wiring connections - 50Hz	For power supply	Quantity		5		
		Remark		Earth wire included		
	For connection with indoor	Quantity		2		
		Remark		F1,F2		
Power supply intake				Both indoor and outdoor unit		
Field earth leakage breaker			mA	300		

Notes

(1) Cooling: indoor temp. 27°CDB, 19.0°CWB; outdoor temp. 35°CDB; equivalent piping length: 5m; level difference: 0m

(2) Heating: indoor temp. 20°CDB; outdoor temp. 7°CDB, 6°CWB; equivalent refrigerant piping: 5m; level difference: 0m

(3) Sound power level is an absolute value that a sound source generates.

(4) Sound pressure level is a relative value, depending on the distance and acoustic environment. For more details, please refer to the sound level drawings.

(5) Sound values are measured in a semi-anechoic room.

(6) In case VRV® indoor units are connected

(7) In case RA indoors are connected

(8) RLA is based on following conditions: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB

(9) Voltage range: units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.

(10) Maximum allowable voltage range variation between phases is 2%.

(11) Select wire size based on the value of MCA

(12) Instead of a fuse, use a circuit breaker

(13) MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker).

(14) MSC means the maximum current during start up of the compressor

(15) EN/IEC 61000-3-12: European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current \> 16A and ≤ 75A per phase

(16) Ssc: Short-circuit power

3 Options

3 - 1 Options

RXYSQ-P8Y1

No	Item	RXYSQ4	RXYSQ5	RXYSQ6
1	Cool / Heat selector	KRC19-26A6		
2	Fixing box	KJB111A		
3	Refnet header	KHRQ22M29H		
4	Refnet joint	KHRQ22M20TA		
5	Central drain plug	KKPJ5F180		
6	Branch provider (2 rooms)	BPMKS967B2B		
7	Branch provider (3 rooms)	BPMKS967B3B		

4TW33621-3

NOTES

Note: All options are kits.

4 Capacity tables

4 - 1 Capacity Table Legend

English - English - αγγλικά - Inglés	Deutsch	Ελληνικά	Español
AFR: Air flow rate	AFR: Luftdurchsatz	AFR: Ταχύτητα ροής αέρα	AFR: Caudal de aire
BF: Bypass factor	BF: Bypassfaktor	BF: Παράγοντας παράκαμψης	BF: Factor de derivación
TC ratio	TC-Verhältnis	Αναλογία TC	Relación TC
°CDB	°CDB	°CDB	°CDB
SHF ratio	SHF-Verhältnis	Αναλογία SHF	Relación SHF
°CWB	°CWB	°CWB	°CWB
EDB: Entering dry bulb temp. (°C)	EDB: Temperaturfühler Eintrittswasser	EDB: Είσοδος σε θερμ. λυχνίας ασφύγρανσης.	EDB: Temperatura de bulbo seco de entrada
EWB: Entering wet bulb temp. (°C)	EWB: Eingangs-Feuchttemp.	EWB: Είσοδος σε θερμ. υγρού βολβού	EWB: Temperatura de bulbo húmedo de entrada
Indoor air temperature: °CDB	Innen-Lufttemp.: °CDB	Θερμοκρ. εσωτ. Αέρα.: °CDB	Temp. de aire interior: °CDB
Single module and 2 module systems (not applicable for 3 module systems)	Einzel-Modul- und Zwei-Modul-Systeme (nicht geeignet für Drei-Modul-Systeme)	Μεμονωμένη μονάδα και 2 συστήματα μονάδων (δεν ισχύει για συστήματα 3 μονάδων)	Sistemas de uno y dos módulos (no aplicable a sistemas de 3 módulos)
Outdoor air temp. (°CDB)	Außen-Lufttemp.(°CDB)	Εξωτερική εσωτ. Αέρα (°CDB)	Temp. de aire exterior (°CDB)
Unit size	Gerätegröße	Μέγεθος μονάδας	Tamaño de unidad
PI: Power Input: kW (compressor + outdoor fan motor)	PI: Leistungsaufnahme: kW (Verdichter +	PI: Ισχύς εισόδου: kW (Λειτουργία + Μοτέρ εξωτερικού	PI: Consumo: kW (compresor + motor de ventilador
SHC: Sensible heat Capacity (kW)	SHC: Sensible Wärmekapazität	SHC: Απόδοση αισθητής θέρμανσης	SHC: Capacidad de calor sensible
TC: Total Capacity: kW	TC: Gesamtleistung: kW	TC: Συνολική απόδοση : kW	TC: Capacidad total: kW
Nominal capacity	Nennwert Kühlleistung	Ονομαστική Απόδοση	Nominal Capacidad

English - Anglais - Inglese - Engels	Français	Italiano	Nederlands
AFR: Air flow rate	AFR: Débit d'air	AFR: Portata d'aria	AFR: Luchtdebiet
BF: Bypass factor	BF: Facteur de dérivation	BF: Fattore di bypass	BF: Bypassfactor
TC ratio	Rapport TC	Rapporto TC	TC-ratio
°CDB	°CDB	°CDB	°CDB
SHF ratio	Rapport FCS	Rapporto SHF	WGF-ratio
°CWB	°CWB	°CWB	°CWB
EDB: Entering dry bulb temp. (°C)	EDB: Température ambiante réservoir sec	EDB: Temp. bulbo secco in entrata	EDB: Temperatuur ingaand droge bol
EWB: Entering wet bulb temp. (°C)	EWB: Température d'entrée du réservoir humide	EWB: Temp. bulbo umido in entrata	EWB: Temperatuur ingaand natte bol
Indoor air temperature: °CDB	Temp. de l'air intérieur: °CDB	Temp. aria interna: °CDB	Binnenluchttemp: °CDB
Single module and 2 module systems (not applicable for 3 module systems)	Ensemble à module unique et à 2 modules (pas d'application pour les ensembles à 3 modules)	Sistemi ad unità singola e a 2 unità (non applicabile per sistemi a 3 unità)	Toestellen met enkele module en met 2 modules (niet toepasbaar voor toestellen met 3 modules)
Outdoor air temp. (°CDB)	Temp. de l'air extérieur (°CDB)	Temp. aria esterno (°CDB)	Buitenluchttemp. (°CDB)
Unit size	Taille de l'unité	Dim. Unità	Grootte van de eenheid
PI: Power Input: kW (compressor + outdoor fan motor)	PI: Puissance d'entrée: kW (Compresseur+ moteur du	PI: Potenza assorbita: kW (compressore + motore vent.	PI: Vermogeninput: kW (compressor + Motor v/d
SHC: Sensible heat Capacity (kW)	SHC: Puissance calorifique sensible	SHC: Capacità termica sensibile	SHC: Voelbare verwarmingscapaciteit
TC: Total Capacity: kW	TC: Puissance totale: kW	TC: Capacità totale: kW	TC: Totaal vermogen: kW
Nominal capacity	Capacité Nominale	Capacità nominale	Nominaal Capaciteit

English - английский - İngilizce	Русский	Türkçe
AFR: Air flow rate	AFR: Скорость воздушного потока	AFR: Hava akış hızı
BF: Bypass factor	BF: Коэффициент байпассирования	BF: Baypas faktörü
TC ratio	Коэфф. TC	TC oranı
°CDB	°CDB	°CDB
SHF ratio	Коэфф. SHF	SHF oranı
°CWB	°CWB	°CWB
EDB: Entering dry bulb temp. (°C)	EDB: Температуре на входе сухого термометра.	EDB: Giriş kuru hazne sıcaklığı
EWB: Entering wet bulb temp. (°C)	EWB: Температуре на входе влажного термометра.	EWB: Giriş ıslak hazne sıcaklığı
Indoor air temperature: °CDB	Внутренняя температура воздуха: °CDB	İç hava sıcaklığı: °CDB
Single module and 2 module systems (not applicable for 3 module systems)	Одномодульная и 2-модульная системы (не относятся к 3-модульным системам)	Tek modüllü ve 2 modüllü sistemler (3 modüllü sistemler için geçerli değildir)
Outdoor air temp. (°CDB)	Наружная температура воздуха (°CDB)	Dış hava sıcaklığı (°CDB)
Unit size	Размер элемента	Ünite büyüklüğü
PI: Power Input: kW (compressor + outdoor fan motor)	PI: Входная мощность : kW (Компрессор + мотор	PI: Güç Girişi: kW (Kompresör + Dış fan motoru)
SHC: Sensible Heat Capacity (kW)	SHC: Ονομαστική αισθητή απόδοση : kW	SHC: Hissedilebilir ısı kapasitesi
TC: Total Capacity: kW	TC: Общая мощность: kW	TC: Toplam kapasite: kW
Nominal capacity	Номинальная Мощность	Nominal Kapasite

0002

4 Capacity tables

4 - 2 Cooling Capacity Tables

RXYSQ4P8Y1

Total capacity (kW)
Power Input (kW) (Compressor + outdoor fan motor)

Combination (%) (Capacity index)	Outdoor air temperature (°CDB)	Indoor air temp (°CWB)													
		14.0		16.0		18.0		19.0		20.0		22.0		24.0	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
110% 13.86 kW	10	9.35	1.27	11.2	1.55	13.0	1.84	13.9	1.99	14.8	2.14	16.6	2.44	18.4	2.75
	12	9.35	1.30	11.2	1.58	13.0	1.87	13.9	2.03	14.8	2.18	16.6	2.49	18.2	2.75
	14	9.35	1.32	11.2	1.61	13.0	1.91	13.9	2.07	14.8	2.22	16.6	2.54	17.9	2.74
	16	9.35	1.34	11.2	1.64	13.0	1.95	13.9	2.11	14.8	2.26	16.6	2.63	17.7	2.89
	18	9.35	1.37	11.2	1.67	13.0	1.99	13.9	2.16	14.8	2.38	16.6	2.84	17.5	3.04
	20	9.35	1.40	11.2	1.70	13.0	2.10	13.9	2.32	14.8	2.56	16.6	3.05	17.2	3.19
	21	9.35	1.41	11.2	1.76	13.0	2.18	13.9	2.41	14.8	2.65	16.6	3.17	17.1	3.26
	23	9.35	1.48	11.2	1.88	13.0	2.34	13.9	2.58	14.8	2.84	16.5	3.38	16.9	3.41
	25	9.35	1.58	11.2	2.01	13.0	2.50	13.9	2.77	14.8	3.05	16.3	3.53	16.6	3.56
	27	9.35	1.68	11.2	2.15	13.0	2.68	13.9	2.96	14.8	3.26	16.0	3.68	16.4	3.71
	29	9.35	1.79	11.2	2.29	13.0	2.86	13.9	3.17	14.8	3.49	15.8	3.83	16.1	3.86
	31	9.35	1.91	11.2	2.45	13.0	3.05	13.9	3.38	14.8	3.73	15.6	3.98	15.9	4.01
	33	9.35	2.03	11.2	2.61	13.0	3.26	13.9	3.61	14.8	3.98	15.3	4.13	15.7	4.16
	35	9.35	2.16	11.2	2.78	13.0	3.48	13.9	3.85	14.7	4.24	15.1	4.28	15.4	4.31
	37	9.35	2.30	11.2	2.96	13.0	3.71	13.9	4.11	14.5	4.39	14.8	4.43	15.2	4.46
	39	9.35	2.44	11.2	3.15	13.0	3.95	13.9	4.39	14.3	4.54	14.6	4.58	14.9	4.62
100% 12.60 kW	10	8.50	1.15	10.1	1.39	11.8	1.65	12.6	1.78	13.4	1.92	15.1	2.19	16.7	2.47
	12	8.50	1.17	10.1	1.42	11.8	1.68	12.6	1.81	13.4	1.95	15.1	2.23	16.7	2.51
	14	8.50	1.19	10.1	1.44	11.8	1.71	12.6	1.85	13.4	1.99	15.1	2.27	16.7	2.56
	16	8.50	1.21	10.1	1.47	11.8	1.74	12.6	1.89	13.4	2.03	15.1	2.32	16.7	2.67
	18	8.50	1.23	10.1	1.50	11.8	1.78	12.6	1.92	13.4	2.07	15.1	2.45	16.7	2.87
	20	8.50	1.26	10.1	1.53	11.8	1.83	12.6	2.02	13.4	2.22	15.1	2.64	16.7	3.09
	21	8.50	1.27	10.1	1.54	11.8	1.90	12.6	2.09	13.4	2.30	15.1	2.73	16.7	3.21
	23	8.50	1.30	10.1	1.65	11.8	2.03	12.6	2.24	13.4	2.46	15.1	2.93	16.5	3.39
	25	8.50	1.39	10.1	1.76	11.8	2.17	12.6	2.40	13.4	2.64	15.1	3.14	16.3	3.53
	27	8.50	1.48	10.1	1.88	11.8	2.32	12.6	2.57	13.4	2.82	15.1	3.36	16.1	3.68
	29	8.50	1.58	10.1	2.00	11.8	2.48	12.6	2.74	13.4	3.01	15.1	3.60	15.8	3.83
	31	8.50	1.68	10.1	2.13	11.8	2.65	12.6	2.93	13.4	3.22	15.1	3.85	15.6	3.98
	33	8.50	1.78	10.1	2.27	11.8	2.82	12.6	3.12	13.4	3.44	15.0	4.10	15.3	4.13
	35	8.50	1.90	10.1	2.42	11.8	3.01	12.6	3.33	13.4	3.67	14.8	4.25	15.1	4.28
	37	8.50	2.01	10.1	2.57	11.8	3.21	12.6	3.55	13.4	3.91	14.6	4.40	14.9	4.43
	39	8.50	2.14	10.1	2.74	11.8	3.42	12.6	3.78	13.4	4.17	14.3	4.55	14.6	4.58
90% 11.34 kW	10	7.65	1.03	9.13	1.24	10.6	1.46	11.3	1.58	12.1	1.70	13.6	1.94	15.0	2.18
	12	7.65	1.04	9.13	1.26	10.6	1.49	11.3	1.61	12.1	1.73	13.6	1.97	15.0	2.23
	14	7.65	1.06	9.13	1.28	10.6	1.52	11.3	1.64	12.1	1.76	13.6	2.01	15.0	2.27
	16	7.65	1.08	9.13	1.31	10.6	1.55	11.3	1.67	12.1	1.80	13.6	2.05	15.0	2.31
	18	7.65	1.10	9.13	1.33	10.6	1.58	11.3	1.70	12.1	1.83	13.6	2.09	15.0	2.44
	20	7.65	1.12	9.13	1.36	10.6	1.61	11.3	1.74	12.1	1.90	13.6	2.25	15.0	2.63
	21	7.65	1.13	9.13	1.37	10.6	1.64	11.3	1.80	12.1	1.97	13.6	2.33	15.0	2.72
	23	7.65	1.15	9.13	1.43	10.6	1.75	11.3	1.92	12.1	2.11	13.6	2.50	15.0	2.92
	25	7.65	1.21	9.13	1.52	10.6	1.87	11.3	2.06	12.1	2.25	13.6	2.67	15.0	3.13
	27	7.65	1.29	9.13	1.63	10.6	2.00	11.3	2.20	12.1	2.41	13.6	2.86	15.0	3.35
	29	7.65	1.38	9.13	1.73	10.6	2.13	11.3	2.35	12.1	2.57	13.6	3.06	15.0	3.59
	31	7.65	1.46	9.13	1.84	10.6	2.27	11.3	2.50	12.1	2.75	13.6	3.27	15.0	3.83
	33	7.65	1.55	9.13	1.96	10.6	2.42	11.3	2.67	12.1	2.93	13.6	3.49	15.0	4.10
	35	7.65	1.65	9.13	2.09	10.6	2.58	11.3	2.84	12.1	3.12	13.6	3.72	14.8	4.25
	37	7.65	1.75	9.13	2.22	10.6	2.75	11.3	3.03	12.1	3.33	13.6	3.97	14.6	4.40
	39	7.65	1.86	9.13	2.36	10.6	2.92	11.3	3.23	12.1	3.55	13.6	4.23	14.3	4.55
80% 10.08 kW	10	6.80	0.91	8.11	1.09	9.42	1.28	10.1	1.38	10.7	1.48	12.0	1.69	13.4	1.91
	12	6.80	0.93	8.11	1.11	9.42	1.31	10.1	1.41	10.7	1.51	12.0	1.72	13.4	1.94
	14	6.80	0.94	8.11	1.13	9.42	1.33	10.1	1.43	10.7	1.54	12.0	1.76	13.4	1.98
	16	6.80	0.96	8.11	1.15	9.42	1.35	10.1	1.46	10.7	1.57	12.0	1.79	13.4	2.02
	18	6.80	0.97	8.11	1.17	9.42	1.38	10.1	1.49	10.7	1.60	12.0	1.83	13.4	2.06
	20	6.80	0.99	8.11	1.19	9.42	1.41	10.1	1.52	10.7	1.63	12.0	1.89	13.4	2.20
	21	6.80	1.00	8.11	1.20	9.42	1.42	10.1	1.53	10.7	1.66	12.0	1.96	13.4	2.28
	23	6.80	1.02	8.11	1.23	9.42	1.49	10.1	1.63	10.7	1.78	12.0	2.10	13.4	2.44
	25	6.80	1.05	8.11	1.31	9.42	1.59	10.1	1.74	10.7	1.90	12.0	2.25	13.4	2.62
	27	6.80	1.12	8.11	1.39	9.42	1.70	10.1	1.86	10.7	2.03	12.0	2.40	13.4	2.80
	29	6.80	1.19	8.11	1.48	9.42	1.81	10.1	1.99	10.7	2.17	12.0	2.56	13.4	2.99
	31	6.80	1.26	8.11	1.58	9.42	1.93	10.1	2.12	10.7	2.31	12.0	2.74	13.4	3.20
	33	6.80	1.34	8.11	1.68	9.42	2.05	10.1	2.25	10.7	2.47	12.0	2.92	13.4	3.41
	35	6.80	1.42	8.11	1.78	9.42	2.18	10.1	2.40	10.7	2.63	12.0	3.11	13.4	3.64
	37	6.80	1.51	8.11	1.89	9.42	2.32	10.1	2.55	10.7	2.80	12.0	3.32	13.4	3.88
	39	6.80	1.60	8.11	2.01	9.42	2.47	10.1	2.72	10.7	2.98	12.0	3.53	13.4	4.14

NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - примечания

The above table shows the average value of conditions which may occur.
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.

4TW33652-1A (1-2)

4 Capacity tables

4 - 2 Cooling Capacity Tables

RXYSQ4P8Y1

Total capacity (kW)
Power Input (kW) (Compressor + outdoor fan motor)

Combination (%) (Capacity index)	Outdoor air temperature (°CDB)	Indoor air temp (°CWB)													
		14.0		16.0		18.0		19.0		20.0		22.0		24.0	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
70% 8.82 kW	10	5.95	0.80	7.10	0.95	8.25	1.11	8.82	1.19	9.39	1.28	10.5	1.45	11.7	1.63
	12	5.95	0.81	7.10	0.97	8.25	1.13	8.82	1.21	9.39	1.30	10.5	1.48	11.7	1.66
	14	5.95	0.83	7.10	0.98	8.25	1.15	8.82	1.24	9.39	1.32	10.5	1.51	11.7	1.70
	16	5.95	0.84	7.10	1.00	8.25	1.17	8.82	1.26	9.39	1.35	10.5	1.54	11.7	1.73
	18	5.95	0.85	7.10	1.02	8.25	1.19	8.82	1.28	9.39	1.38	10.5	1.57	11.7	1.76
	20	5.95	0.87	7.10	1.04	8.25	1.21	8.82	1.31	9.39	1.40	10.5	1.60	11.7	1.81
	21	5.95	0.88	7.10	1.05	8.25	1.23	8.82	1.32	9.39	1.42	10.5	1.62	11.7	1.88
	23	5.95	0.89	7.10	1.06	8.25	1.25	8.82	1.36	9.39	1.48	10.5	1.74	11.7	2.01
	25	5.95	0.91	7.10	1.11	8.25	1.33	8.82	1.46	9.39	1.58	10.5	1.86	11.7	2.15
	27	5.95	0.96	7.10	1.18	8.25	1.42	8.82	1.55	9.39	1.69	10.5	1.98	11.7	2.30
	29	5.95	1.02	7.10	1.25	8.25	1.51	8.82	1.65	9.39	1.80	10.5	2.11	11.7	2.45
	31	5.95	1.08	7.10	1.33	8.25	1.61	8.82	1.76	9.39	1.92	10.5	2.25	11.7	2.62
	33	5.95	1.14	7.10	1.41	8.25	1.71	8.82	1.87	9.39	2.04	10.5	2.40	11.7	2.79
	35	5.95	1.21	7.10	1.50	8.25	1.82	8.82	1.99	9.39	2.17	10.5	2.56	11.7	2.97
	37	5.95	1.28	7.10	1.59	8.25	1.93	8.82	2.12	9.39	2.31	10.5	2.72	11.7	3.17
	39	5.95	1.36	7.10	1.68	8.25	2.05	8.82	2.25	9.39	2.46	10.5	2.90	11.7	3.38
60% 7.56 kW	10	5.10	0.70	6.09	0.82	7.07	0.95	7.56	1.01	8.05	1.08	9.03	1.22	10.0	1.37
	12	5.10	0.71	6.09	0.83	7.07	0.96	7.56	1.03	8.05	1.10	9.03	1.25	10.0	1.40
	14	5.10	0.72	6.09	0.84	7.07	0.98	7.56	1.05	8.05	1.12	9.03	1.27	10.0	1.42
	16	5.10	0.73	6.09	0.86	7.07	1.00	7.56	1.07	8.05	1.14	9.03	1.29	10.0	1.45
	18	5.10	0.74	6.09	0.87	7.07	1.01	7.56	1.09	8.05	1.16	9.03	1.32	10.0	1.48
	20	5.10	0.75	6.09	0.89	7.07	1.03	7.56	1.11	8.05	1.18	9.03	1.34	10.0	1.51
	21	5.10	0.76	6.09	0.89	7.07	1.04	7.56	1.12	8.05	1.19	9.03	1.36	10.0	1.52
	23	5.10	0.77	6.09	0.91	7.07	1.06	7.56	1.14	8.05	1.22	9.03	1.41	10.0	1.62
	25	5.10	0.78	6.09	0.93	7.07	1.10	7.56	1.20	8.05	1.29	9.03	1.50	10.0	1.73
	27	5.10	0.81	6.09	0.98	7.07	1.17	7.56	1.27	8.05	1.38	9.03	1.60	10.0	1.85
	29	5.10	0.86	6.09	1.04	7.07	1.25	7.56	1.35	8.05	1.47	9.03	1.71	10.0	1.97
	31	5.10	0.91	6.09	1.11	7.07	1.32	7.56	1.44	8.05	1.56	9.03	1.82	10.0	2.10
	33	5.10	0.96	6.09	1.17	7.07	1.40	7.56	1.53	8.05	1.66	9.03	1.94	10.0	2.23
	35	5.10	1.02	6.09	1.24	7.07	1.49	7.56	1.62	8.05	1.76	9.03	2.06	10.0	2.38
	37	5.10	1.08	6.09	1.32	7.07	1.58	7.56	1.72	8.05	1.87	9.03	2.19	10.0	2.53
	39	5.10	1.14	6.09	1.39	7.07	1.68	7.56	1.83	8.05	1.99	9.03	2.32	10.0	2.69
50% 6.30 kW	10	4.25	0.60	5.07	0.69	5.89	0.79	6.30	0.85	6.71	0.90	7.53	1.01	8.35	1.13
	12	4.25	0.61	5.07	0.70	5.89	0.81	6.30	0.86	6.71	0.91	7.53	1.03	8.35	1.14
	14	4.25	0.62	5.07	0.71	5.89	0.82	6.30	0.87	6.71	0.93	7.53	1.04	8.35	1.16
	16	4.25	0.62	5.07	0.72	5.89	0.83	6.30	0.89	6.71	0.94	7.53	1.06	8.35	1.19
	18	4.25	0.63	5.07	0.74	5.89	0.85	6.30	0.90	6.71	0.96	7.53	1.08	8.35	1.21
	20	4.25	0.64	5.07	0.75	5.89	0.86	6.30	0.92	6.71	0.98	7.53	1.10	8.35	1.23
	21	4.25	0.65	5.07	0.75	5.89	0.87	6.30	0.93	6.71	0.99	7.53	1.11	8.35	1.24
	23	4.25	0.66	5.07	0.77	5.89	0.88	6.30	0.94	6.71	1.00	7.53	1.13	8.35	1.27
	25	4.25	0.67	5.07	0.78	5.89	0.90	6.30	0.96	6.71	1.04	7.53	1.19	8.35	1.36
	27	4.25	0.68	5.07	0.81	5.89	0.95	6.30	1.02	6.71	1.10	7.53	1.27	8.35	1.44
	29	4.25	0.72	5.07	0.85	5.89	1.01	6.30	1.09	6.71	1.17	7.53	1.35	8.35	1.54
	31	4.25	0.76	5.07	0.90	5.89	1.07	6.30	1.15	6.71	1.24	7.53	1.43	8.35	1.64
	33	4.25	0.80	5.07	0.96	5.89	1.13	6.30	1.22	6.71	1.32	7.53	1.52	8.35	1.74
	35	4.25	0.84	5.07	1.01	5.89	1.20	6.30	1.29	6.71	1.40	7.53	1.61	8.35	1.85
	37	4.25	0.89	5.07	1.07	5.89	1.27	6.30	1.37	6.71	1.48	7.53	1.71	8.35	1.96
	39	4.25	0.94	5.07	1.13	5.89	1.34	6.30	1.45	6.71	1.57	7.53	1.82	8.35	2.09

NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - примечания

The above table shows the average value of conditions which may occur.
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.

4TW33652-1A (2-2)

4 Capacity tables

4 - 2 Cooling Capacity Tables

RXYSQ5P8Y1

Total capacity [kW], power Input [kW] (Compressor + Outdoor fan motor)

Combination [%] (Capacity index)	Outdoor air temp. °CDB	Indoor air temp. [°CWB] 14,0 TC kW	14,0 PI kW	16,0 TC kW	16,0 PI kW	18,0 TC kW	18,0 PI kW	19,0 TC kW	19,0 PI kW	20,0 TC kW	20,0 PI kW	22,0 TC kW	22,0 PI kW	24,0 TC kW	24,0 PI kW
130% 18.20 kW	10	12,3	1,66	14,6	2,03	17,0	2,42	18,2	2,62	19,1	2,75	19,6	2,63	20,0	2,51
	12	12,3	1,69	14,6	2,07	17,0	2,47	18,2	2,66	18,9	2,73	19,3	2,61	19,8	2,57
	14	12,3	1,72	14,6	2,11	17,0	2,51	18,2	2,71	18,6	2,71	19,1	2,69	19,5	2,71
	16	12,3	1,76	14,6	2,15	17,0	2,56	18,2	2,80	18,4	2,81	18,8	2,83	19,3	2,86
	18	12,3	1,79	14,6	2,20	17,0	2,73	17,9	2,94	18,1	2,95	18,6	2,98	19,0	3,00
	20	12,3	1,83	14,6	2,34	17,0	2,93	17,7	3,08	17,9	3,10	18,3	3,12	18,8	3,15
	21	12,3	1,88	14,6	2,42	17,0	3,04	17,5	3,15	17,8	3,17	18,2	3,20	18,7	3,22
	23	12,3	2,01	14,6	2,60	17,0	3,26	17,3	3,30	17,5	3,31	18,0	3,34	18,4	3,37
	25	12,3	2,15	14,6	2,78	16,8	3,43	17,1	3,44	17,3	3,46	17,7	3,49	18,2	3,52
	27	12,3	2,30	14,6	2,98	16,6	3,57	16,8	3,59	17,0	3,60	17,5	3,64	17,9	3,67
	29	12,3	2,45	14,6	3,18	16,3	3,71	16,6	3,73	16,8	3,75	17,2	3,78	17,7	3,82
	31	12,3	2,62	14,6	3,40	16,1	3,86	16,3	3,88	16,5	3,90	17,0	3,93	17,4	3,97
	33	12,3	2,79	14,6	3,63	15,8	4,00	16,1	4,02	16,3	4,04	16,7	4,08	17,2	4,12
	35	12,3	2,97	14,6	3,87	15,6	4,15	15,8	4,17	16,0	4,19	16,5	4,23	16,9	4,27
	37	12,3	3,16	14,6	4,13	15,3	4,30	15,6	4,32	15,8	4,34	16,2	4,38	16,7	4,43
	39	12,3	3,37	14,6	4,40	15,1	4,44	15,3	4,47	15,5	4,49	16,0	4,54	16,4	4,58
120% 16.80 kW	10	11,3	1,52	13,5	1,86	15,7	2,21	16,8	2,38	17,9	2,56	19,3	2,71	19,7	2,60
	12	11,3	1,55	13,5	1,89	15,7	2,25	16,8	2,43	17,9	2,61	19,0	2,69	19,4	2,58
	14	11,3	1,58	13,5	1,93	15,7	2,29	16,8	2,48	17,9	2,66	18,8	2,68	19,2	2,69
	16	11,3	1,61	13,5	1,96	15,7	2,34	16,8	2,52	17,9	2,73	18,5	2,82	18,9	2,84
	18	11,3	1,64	13,5	2,00	15,7	2,42	16,8	2,67	17,9	2,94	18,3	2,96	18,7	2,98
	20	11,3	1,67	13,5	2,08	15,7	2,60	16,8	2,88	17,6	3,08	18,0	3,10	18,4	3,13
	21	11,3	1,69	13,5	2,16	15,7	2,69	16,8	2,98	17,5	3,15	17,9	3,18	18,3	3,20
	23	11,3	1,80	13,5	2,31	15,7	2,89	16,8	3,20	17,2	3,29	17,7	3,32	18,1	3,35
	25	11,3	1,92	13,5	2,47	15,7	3,09	16,8	3,42	17,0	3,44	17,4	3,47	17,8	3,50
	27	11,3	2,05	13,5	2,64	15,7	3,31	16,5	3,57	16,7	3,58	17,2	3,61	17,6	3,64
	29	11,3	2,19	13,5	2,82	15,7	3,54	16,3	3,71	16,5	3,73	16,9	3,76	17,3	3,79
	31	11,3	2,33	13,5	3,01	15,7	3,78	16,0	3,86	16,2	3,87	16,7	3,91	17,1	3,94
	33	11,3	2,49	13,5	3,21	15,6	3,98	15,8	4,00	16,0	4,02	16,4	4,06	16,8	4,09
	35	11,3	2,65	13,5	3,43	15,3	4,13	15,5	4,15	15,8	4,17	16,2	4,20	16,6	4,24
	37	11,3	2,82	13,5	3,65	15,1	4,27	15,3	4,29	15,5	4,31	15,9	4,35	16,3	4,39
	39	11,3	3,00	13,5	3,89	14,8	4,42	15,1	4,44	15,3	4,46	15,7	4,50	16,1	4,55
110% 15.40 kW	10	10,4	1,38	12,4	1,68	14,4	1,99	15,4	2,16	16,4	2,32	18,4	2,65	19,3	2,69
	12	10,4	1,40	12,4	1,71	14,4	2,03	15,4	2,20	16,4	2,36	18,4	2,70	19,1	2,68
	14	10,4	1,43	12,4	1,74	14,4	2,07	15,4	2,24	16,4	2,41	18,4	2,75	18,8	2,68
	16	10,4	1,46	12,4	1,78	14,4	2,11	15,4	2,28	16,4	2,46	18,2	2,80	18,6	2,82
	18	10,4	1,48	12,4	1,81	14,4	2,15	15,4	2,35	16,4	2,58	18,0	2,94	18,3	2,96
	20	10,4	1,51	12,4	1,85	14,4	2,28	15,4	2,52	16,4	2,77	17,7	3,09	18,1	3,11
	21	10,4	1,53	12,4	1,90	14,4	2,36	15,4	2,61	16,4	2,87	17,6	3,16	18,0	3,18
	23	10,4	1,60	12,4	2,04	14,4	2,53	15,4	2,80	16,4	3,08	17,3	3,30	17,7	3,33
	25	10,4	1,71	12,4	2,18	14,4	2,71	15,4	3,00	16,4	3,30	17,1	3,45	17,5	3,47
	27	10,4	1,82	12,4	2,33	14,4	2,90	15,4	3,21	16,4	3,54	16,8	3,59	17,2	3,62
	29	10,4	1,94	12,4	2,49	14,4	3,10	15,4	3,43	16,2	3,71	16,6	3,74	17,0	3,76
	31	10,4	2,07	12,4	2,65	14,4	3,31	15,4	3,67	16,0	3,85	16,3	3,88	16,7	3,91
	33	10,4	2,20	12,4	2,83	14,4	3,53	15,4	3,92	15,7	3,99	16,1	4,03	16,5	4,06
	35	10,4	2,34	12,4	3,01	14,4	3,77	15,3	4,12	15,5	4,14	15,8	4,17	16,2	4,21
	37	10,4	2,49	12,4	3,21	14,4	4,02	15,0	4,27	15,2	4,29	15,6	4,32	16,0	4,36
	39	10,4	2,65	12,4	3,41	14,4	4,28	14,8	4,41	15,0	4,43	15,4	4,47	15,7	4,51
100% 14.00 kW	10	9,45	1,24	11,3	1,51	13,1	1,79	14,0	1,93	14,9	2,08	16,7	2,37	18,6	2,67
	12	9,45	1,27	11,3	1,54	13,1	1,82	14,0	1,97	14,9	2,12	16,7	2,42	18,6	2,72
	14	9,45	1,29	11,3	1,56	13,1	1,86	14,0	2,00	14,9	2,16	16,7	2,46	18,5	2,76
	16	9,45	1,31	11,3	1,59	13,1	1,89	14,0	2,04	14,9	2,20	16,7	2,51	18,2	2,80
	18	9,45	1,34	11,3	1,62	13,1	1,93	14,0	2,08	14,9	2,24	16,7	2,66	18,0	2,94
	20	9,45	1,36	11,3	1,66	13,1	1,99	14,0	2,19	14,9	2,40	16,7	2,86	17,7	3,09
	21	9,45	1,37	11,3	1,67	13,1	2,06	14,0	2,27	14,9	2,49	16,7	2,96	17,6	3,16
	23	9,45	1,41	11,3	1,78	13,1	2,20	14,0	2,43	14,9	2,67	16,7	3,18	17,4	3,30
	25	9,45	1,51	11,3	1,91	13,1	2,36	14,0	2,60	14,9	2,86	16,7	3,41	17,1	3,45
	27	9,45	1,60	11,3	2,04	13,1	2,52	14,0	2,78	14,9	3,06	16,5	3,57	16,9	3,59
	29	9,45	1,71	11,3	2,17	13,1	2,69	14,0	2,97	14,9	3,27	16,3	3,71	16,6	3,74
	31	9,45	1,82	11,3	2,31	13,1	2,87	14,0	3,17	14,9	3,49	16,0	3,85	16,4	3,88
	33	9,45	1,93	11,3	2,46	13,1	3,06	14,0	3,39	14,9	3,73	15,8	4,00	16,1	4,03
	35	9,45	2,05	11,3	2,62	13,1	3,26	14,0	3,61	14,9	3,97	15,5	4,15	15,9	4,18
	37	9,45	2,18	11,3	2,79	13,1	3,48	14,0	3,85	14,9	4,24	15,3	4,29	15,6	4,33
	39	9,45	2,32	11,3	2,97	13,1	3,70	14,0	4,10	14,7	4,40	15,0	4,44	15,4	4,47

NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - Примечания - NOTLAR

1. The above table shows the average value of conditions which may occur.
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.
Yukarýdaki tablo meydana gelebilecek koþullarýn ortalama deðerini göstermektedir.

4TW33652-1

4 Capacity tables

4 - 2 Cooling Capacity Tables

RXYSQ5P8Y1

Total capacity [kW], power Input [kW] (Compressor + Outdoor fan motor)

Combination [%] (Capacity index)	Outdoor air temp. °CDB	Indoor air temp. [°CWB] 14,0 TC kW	14,0 PI kW	16,0 TC kW	16,0 PI kW	18,0 TC kW	18,0 PI kW	19,0 TC kW	19,0 PI kW	20,0 TC kW	20,0 PI kW	22,0 TC kW	22,0 PI kW	24,0 TC kW	24,0 PI kW
90%	10	8,50	1,11	10,1	1,34	11,8	1,59	12,6	1,71	13,4	1,84	15,1	2,10	16,7	2,37
12.60 kW	12	8,50	1,13	10,1	1,37	11,8	1,61	12,6	1,74	13,4	1,87	15,1	2,14	16,7	2,41
	14	8,50	1,15	10,1	1,39	11,8	1,64	12,6	1,78	13,4	1,91	15,1	2,18	16,7	2,46
	16	8,50	1,17	10,1	1,42	11,8	1,68	12,6	1,81	13,4	1,95	15,1	2,22	16,7	2,51
	18	8,50	1,19	10,1	1,44	11,8	1,71	12,6	1,85	13,4	1,98	15,1	2,27	16,7	2,65
	20	8,50	1,22	10,1	1,47	11,8	1,74	12,6	1,88	13,4	2,06	15,1	2,44	16,7	2,85
	21	8,50	1,23	10,1	1,49	11,8	1,77	12,6	1,95	13,4	2,13	15,1	2,53	16,7	2,95
	23	8,50	1,25	10,1	1,55	11,8	1,90	12,6	2,09	13,4	2,28	15,1	2,71	16,7	3,17
	25	8,50	1,32	10,1	1,65	11,8	2,03	12,6	2,23	13,4	2,44	15,1	2,90	16,7	3,40
	27	8,50	1,40	10,1	1,76	11,8	2,17	12,6	2,38	13,4	2,61	15,1	3,10	16,5	3,57
	29	8,50	1,49	10,1	1,88	11,8	2,31	12,6	2,55	13,4	2,79	15,1	3,32	16,3	3,71
	31	8,50	1,59	10,1	2,00	11,8	2,46	12,6	2,72	13,4	2,98	15,1	3,54	16,0	3,85
	33	8,50	1,68	10,1	2,13	11,8	2,63	12,6	2,89	13,4	3,18	15,1	3,78	15,8	4,00
	35	8,50	1,79	10,1	2,26	11,8	2,80	12,6	3,08	13,4	3,39	15,1	4,04	15,5	4,14
	37	8,50	1,90	10,1	2,41	11,8	2,98	12,6	3,28	13,4	3,61	15,0	4,26	15,3	4,29
	39	8,50	2,01	10,1	2,56	11,8	3,17	12,6	3,50	13,4	3,85	14,7	4,41	15,0	4,44
80%	10	7,56	0,99	9,02	1,18	10,5	1,39	11,2	1,50	11,9	1,61	13,4	1,83	14,8	2,07
11.20 kW	12	7,56	1,00	9,02	1,20	10,5	1,42	11,2	1,53	11,9	1,64	13,4	1,87	14,8	2,10
	14	7,56	1,02	9,02	1,23	10,5	1,44	11,2	1,55	11,9	1,67	13,4	1,90	14,8	2,14
	16	7,56	1,04	9,02	1,25	10,5	1,47	11,2	1,58	11,9	1,70	13,4	1,94	14,8	2,19
	18	7,56	1,06	9,02	1,27	10,5	1,50	11,2	1,61	11,9	1,73	13,4	1,98	14,8	2,23
	20	7,56	1,07	9,02	1,29	10,5	1,53	11,2	1,65	11,9	1,77	13,4	2,05	14,8	2,39
	21	7,56	1,08	9,02	1,31	10,5	1,54	11,2	1,66	11,9	1,80	13,4	2,12	14,8	2,47
	23	7,56	1,10	9,02	1,33	10,5	1,62	11,2	1,77	11,9	1,93	13,4	2,28	14,8	2,65
	25	7,56	1,14	9,02	1,42	10,5	1,73	11,2	1,89	11,9	2,06	13,4	2,44	14,8	2,84
	27	7,56	1,21	9,02	1,51	10,5	1,84	11,2	2,02	11,9	2,20	13,4	2,60	14,8	3,04
	29	7,56	1,29	9,02	1,61	10,5	1,96	11,2	2,15	11,9	2,35	13,4	2,78	14,8	3,24
	31	7,56	1,37	9,02	1,71	10,5	2,09	11,2	2,29	11,9	2,51	13,4	2,97	14,8	3,47
	33	7,56	1,45	9,02	1,82	10,5	2,22	11,2	2,44	11,9	2,67	13,4	3,16	14,8	3,70
	35	7,56	1,54	9,02	1,93	10,5	2,37	11,2	2,60	11,9	2,85	13,4	3,37	14,8	3,95
	37	7,56	1,63	9,02	2,05	10,5	2,52	11,2	2,77	11,9	3,03	13,4	3,60	14,8	4,21
	39	7,56	1,73	9,02	2,18	10,5	2,67	11,2	2,94	11,9	3,23	13,4	3,83	14,7	4,40
70%	10	6,61	0,87	7,89	1,03	9,16	1,20	9,80	1,29	10,4	1,39	11,7	1,58	13,0	1,77
9.80 kW	12	6,61	0,88	7,89	1,05	9,16	1,22	9,80	1,32	10,4	1,41	11,7	1,60	13,0	1,80
	14	6,61	0,90	7,89	1,07	9,16	1,25	9,80	1,34	10,4	1,44	11,7	1,63	13,0	1,84
	16	6,61	0,91	7,89	1,08	9,16	1,27	9,80	1,36	10,4	1,46	11,7	1,67	13,0	1,87
	18	6,61	0,93	7,89	1,10	9,16	1,29	9,80	1,39	10,4	1,49	11,7	1,70	13,0	1,91
	20	6,61	0,94	7,89	1,12	9,16	1,32	9,80	1,42	10,4	1,52	11,7	1,73	13,0	1,96
	21	6,61	0,95	7,89	1,13	9,16	1,33	9,80	1,43	10,4	1,53	11,7	1,76	13,0	2,03
	23	6,61	0,97	7,89	1,15	9,16	1,36	9,80	1,48	10,4	1,61	11,7	1,88	13,0	2,18
	25	6,61	0,98	7,89	1,20	9,16	1,45	9,80	1,58	10,4	1,72	11,7	2,01	13,0	2,33
	27	6,61	1,04	7,89	1,28	9,16	1,54	9,80	1,68	10,4	1,83	11,7	2,15	13,0	2,49
	29	6,61	1,10	7,89	1,36	9,16	1,64	9,80	1,79	10,4	1,95	11,7	2,29	13,0	2,66
	31	6,61	1,17	7,89	1,44	9,16	1,75	9,80	1,91	10,4	2,08	11,7	2,44	13,0	2,84
	33	6,61	1,24	7,89	1,53	9,16	1,86	9,80	2,03	10,4	2,21	11,7	2,60	13,0	3,03
	35	6,61	1,31	7,89	1,62	9,16	1,97	9,80	2,16	10,4	2,35	11,7	2,77	13,0	3,22
	37	6,61	1,39	7,89	1,72	9,16	2,09	9,80	2,29	10,4	2,50	11,7	2,95	13,0	3,44
	39	6,61	1,47	7,89	1,83	9,16	2,22	9,80	2,44	10,4	2,66	11,7	3,14	13,0	3,66
60%	10	5,67	0,76	6,76	0,89	7,85	1,03	8,40	1,10	8,95	1,17	10,0	1,33	11,1	1,49
8.40 kW	12	5,67	0,77	6,76	0,90	7,85	1,04	8,40	1,12	8,95	1,19	10,0	1,35	11,1	1,51
	14	5,67	0,78	6,76	0,92	7,85	1,06	8,40	1,14	8,95	1,22	10,0	1,38	11,1	1,54
	16	5,67	0,79	6,76	0,93	7,85	1,08	8,40	1,16	8,95	1,24	10,0	1,40	11,1	1,57
	18	5,67	0,80	6,76	0,95	7,85	1,10	8,40	1,18	8,95	1,26	10,0	1,43	11,1	1,60
	20	5,67	0,81	6,76	0,96	7,85	1,12	8,40	1,20	8,95	1,28	10,0	1,46	11,1	1,63
	21	5,67	0,82	6,76	0,97	7,85	1,13	8,40	1,21	8,95	1,30	10,0	1,47	11,1	1,65
	23	5,67	0,83	6,76	0,99	7,85	1,15	8,40	1,23	8,95	1,32	10,0	1,53	11,1	1,75
	25	5,67	0,85	6,76	1,00	7,85	1,19	8,40	1,30	8,95	1,40	10,0	1,63	11,1	1,87
	27	5,67	0,88	6,76	1,07	7,85	1,27	8,40	1,38	8,95	1,49	10,0	1,74	11,1	2,00
	29	5,67	0,93	6,76	1,13	7,85	1,35	8,40	1,47	8,95	1,59	10,0	1,85	11,1	2,13
	31	5,67	0,99	6,76	1,20	7,85	1,43	8,40	1,56	8,95	1,69	10,0	1,97	11,1	2,27
	33	5,67	1,04	6,76	1,27	7,85	1,52	8,40	1,66	8,95	1,80	10,0	2,10	11,1	2,42
	35	5,67	1,10	6,76	1,35	7,85	1,62	8,40	1,76	8,95	1,91	10,0	2,23	11,1	2,58
	37	5,67	1,17	6,76	1,43	7,85	1,71	8,40	1,87	8,95	2,03	10,0	2,37	11,1	2,74
	39	5,67	1,23	6,76	1,51	7,85	1,82	8,40	1,98	8,95	2,15	10,0	2,52	11,1	2,92
50%	10	4,72	0,65	5,63	0,75	6,54	0,86	7,00	0,92	7,46	0,98	8,37	1,09	9,28	1,22
7.00 kW	12	4,72	0,66	5,63	0,76	6,54	0,87	7,00	0,93	7,46	0,99	8,37	1,11	9,28	1,24
	14	4,72	0,67	5,63	0,77	6,54	0,89	7,00	0,95	7,46	1,01	8,37	1,13	9,28	1,26
	16	4,72	0,68	5,63	0,79	6,54	0,90	7,00	0,96	7,46	1,02	8,37	1,15	9,28	1,29
	18	4,72	0,69	5,63	0,80	6,54	0,92	7,00	0,98	7,46	1,04	8,37	1,17	9,28	1,31
	20	4,72	0,70	5,63	0,81	6,54	0,93	7,00	0,99	7,46	1,06	8,37	1,19	9,28	1,33
	21	4,72	0,70	5,63	0,82	6,54	0,94	7,00	1,00	7,46	1,07	8,37	1,21	9,28	1,35
	23	4,72	0,71	5,63	0,83	6,54	0,96	7,00	1,02	7,46	1,09	8,37	1,23	9,28	1,38
	25	4,72	0,72	5,63	0,84	6,54	0,97	7,00	1,04	7,46	1,12	8,37	1,29	9,28	1,47
	27	4,72	0,73	5,63	0,87	6,54	1,03	7,00	1,11	7,46	1,19	8,37	1,37	9,28	1,57
	29	4,72	0,78	5,63	0,93	6,54	1,09	7,00	1,18	7,46	1,27	8,37	1,46	9,28	1,67
	31	4,72	0,82	5,63	0,98	6,54	1,16	7,00	1,25	7,46	1,35	8,37	1,55	9,28	1,77
	33	4,72	0,87	5,63	1,04	6,54	1,22	7,00	1,32	7,46	1,43	8,37	1,65	9,28	1,89
	35	4,72	0,91	5,63	1,10	6,54	1,30	7,00	1,40	7,46	1,51	8,37	1,75	9,28	2,00
	37	4,72	0,96	5,63	1,16	6,54	1,37	7,00	1,49	7,46	1,61	8,37	1,86	9,28	2,13
	39	4,72	1,02	5,63	1,22	6,54	1,45	7,00	1,57	7,46	1,70	8,37	1,97	9,28	2,26

4TW33652-1

4 Capacity tables

4 - 2 Cooling Capacity Tables

RXYSQ6P8Y1

Total capacity [kW], power Input [kW] (Compressor + Outdoor fan motor)

Combination [%] (Capacity index)	Outdoor air temp. °CDB	Indoor air temp. [°CWB] 14,0 TC kW	14,0 PI kW	16,0 TC kW	16,0 PI kW	18,0 TC kW	18,0 PI kW	19,0 TC kW	19,0 PI kW	20,0 TC kW	20,0 PI kW	22,0 TC kW	22,0 PI kW	24,0 TC kW	24,0 PI kW
130% 20.80 kW	10	13,6	2,15	16,2	2,63	18,8	3,12	20,2	3,38	20,4	3,31	20,9	3,17	21,4	3,02
	12	13,6	2,19	16,2	2,68	18,8	3,18	19,9	3,36	20,1	3,29	20,6	3,15	21,1	3,09
	14	13,6	2,23	16,2	2,73	18,8	3,24	19,6	3,34	19,9	3,27	20,4	3,24	20,9	3,27
	16	13,6	2,27	16,2	2,78	18,8	3,31	19,4	3,37	19,6	3,39	20,1	3,42	20,6	3,45
	18	13,6	2,31	16,2	2,84	18,8	3,52	19,1	3,54	19,3	3,56	19,8	3,59	20,3	3,62
	20	13,6	2,36	16,2	3,02	18,6	3,70	18,8	3,71	19,1	3,73	19,6	3,77	20,1	3,80
	21	13,6	2,43	16,2	3,13	18,5	3,78	18,7	3,80	19,0	3,82	19,4	3,86	19,9	3,89
	23	13,6	2,60	16,2	3,35	18,2	3,96	18,4	3,97	18,7	3,99	19,2	4,03	19,7	4,07
	25	13,6	2,78	16,2	3,59	17,9	4,13	18,2	4,15	18,4	4,17	18,9	4,21	19,4	4,25
	27	13,6	2,97	16,2	3,84	17,7	4,30	17,9	4,32	18,2	4,34	18,7	4,39	19,1	4,43
	29	13,6	3,17	16,2	4,11	17,4	4,48	17,7	4,50	17,9	4,52	18,4	4,57	18,9	4,61
	31	13,6	3,38	16,2	4,39	17,2	4,65	17,4	4,67	17,6	4,70	18,1	4,75	18,6	4,79
	33	13,6	3,60	16,2	4,68	16,9	4,83	17,1	4,85	17,4	4,88	17,9	4,93	18,4	4,98
	35	13,6	3,83	16,1	4,95	16,6	5,00	16,9	5,03	17,1	5,06	17,6	5,11	18,1	5,16
	37	13,6	4,08	15,9	5,12	16,4	5,18	16,6	5,21	16,9	5,24	17,3	5,29	17,8	5,35
	39	13,6	4,35	15,6	5,30	16,1	5,36	16,3	5,39	16,6	5,42	17,1	5,48	17,6	5,54
120% 19.20 kW	10	12,6	1,96	15,0	2,39	17,4	2,85	18,6	3,08	19,8	3,31	20,5	3,27	21,0	3,14
	12	12,6	2,00	15,0	2,44	17,4	2,90	18,6	3,14	19,8	3,37	20,3	3,25	20,7	3,11
	14	12,6	2,03	15,0	2,49	17,4	2,96	18,6	3,20	19,6	3,36	20,0	3,23	20,5	3,25
	16	12,6	2,07	15,0	2,53	17,4	3,01	18,6	3,26	19,3	3,37	19,8	3,39	20,2	3,42
	18	12,6	2,11	15,0	2,58	17,4	3,12	18,6	3,45	19,0	3,54	19,5	3,57	19,9	3,60
	20	12,6	2,15	15,0	2,69	17,4	3,35	18,6	3,69	18,8	3,71	19,2	3,74	19,7	3,77
	21	12,6	2,18	15,0	2,78	17,4	3,47	18,4	3,78	18,6	3,80	19,1	3,83	19,6	3,86
	23	12,6	2,32	15,0	2,98	17,4	3,73	18,2	3,95	18,4	3,97	18,8	4,00	19,3	4,04
	25	12,6	2,48	15,0	3,19	17,4	3,99	17,9	4,12	18,1	4,14	18,6	4,18	19,0	4,22
	27	12,6	2,65	15,0	3,41	17,4	4,27	17,6	4,30	17,9	4,32	18,3	4,36	18,8	4,40
	29	12,6	2,83	15,0	3,64	17,1	4,45	17,4	4,47	17,6	4,49	18,0	4,53	18,5	4,58
	31	12,6	3,01	15,0	3,89	16,9	4,62	17,1	4,65	17,3	4,67	17,8	4,71	18,2	4,76
	33	12,6	3,21	15,0	4,15	16,6	4,80	16,8	4,82	17,1	4,84	17,5	4,89	18,0	4,94
	35	12,6	3,42	15,0	4,42	16,4	4,97	16,6	5,00	16,8	5,02	17,3	5,07	17,7	5,12
	37	12,6	3,64	15,0	4,71	16,1	5,15	16,3	5,17	16,5	5,20	17,0	5,25	17,5	5,30
	39	12,6	3,87	15,0	5,02	15,8	5,32	16,1	5,35	16,3	5,38	16,7	5,43	17,2	5,49
110% 17.60 kW	10	11,5	1,78	13,7	2,17	15,9	2,57	17,1	2,78	18,2	2,99	20,2	3,36	20,6	3,25
	12	11,5	1,81	13,7	2,21	15,9	2,62	17,1	2,84	18,2	3,05	19,9	3,35	20,3	3,23
	14	11,5	1,85	13,7	2,25	15,9	2,67	17,1	2,89	18,2	3,11	19,7	3,33	20,1	3,23
	16	11,5	1,88	13,7	2,29	15,9	2,73	17,1	2,95	18,2	3,17	19,4	3,37	19,8	3,40
	18	11,5	1,92	13,7	2,34	15,9	2,78	17,1	3,03	18,2	3,33	19,1	3,55	19,6	3,57
	20	11,5	1,95	13,7	2,39	15,9	2,94	17,1	3,25	18,2	3,58	18,9	3,72	19,3	3,75
	21	11,5	1,97	13,7	2,46	15,9	3,05	17,1	3,37	18,2	3,71	18,8	3,80	19,2	3,83
	23	11,5	2,06	13,7	2,63	15,9	3,27	17,1	3,62	18,1	3,95	18,5	3,98	18,9	4,01
	25	11,5	2,20	13,7	2,81	15,9	3,50	17,1	3,87	17,8	4,12	18,2	4,15	18,6	4,19
	27	11,5	2,35	13,7	3,01	15,9	3,74	17,1	4,14	17,6	4,29	18,0	4,33	18,4	4,36
	29	11,5	2,51	13,7	3,21	15,9	4,00	17,1	4,43	17,3	4,46	17,7	4,50	18,1	4,54
	31	11,5	2,67	13,7	3,42	15,9	4,27	16,8	4,62	17,0	4,64	17,4	4,68	17,9	4,72
	33	11,5	2,84	13,7	3,65	15,9	4,56	16,6	4,79	16,8	4,81	17,2	4,86	17,6	4,90
	35	11,5	3,02	13,7	3,89	15,9	4,86	16,3	4,97	16,5	4,99	16,9	5,03	17,3	5,08
	37	11,5	3,21	13,7	4,14	15,8	5,12	16,0	5,14	16,2	5,16	16,7	5,21	17,1	5,26
	39	11,5	3,42	13,7	4,41	15,6	5,29	15,8	5,32	16,0	5,34	16,4	5,39	16,8	5,44
100% 16.00 kW	10	10,5	1,61	12,5	1,95	14,5	2,31	15,5	2,49	16,5	2,68	18,5	3,06	20,2	3,36
	12	10,5	1,63	12,5	1,98	14,5	2,35	15,5	2,54	16,5	2,73	18,5	3,12	20,0	3,34
	14	10,5	1,66	12,5	2,02	14,5	2,39	15,5	2,59	16,5	2,78	18,5	3,18	19,7	3,32
	16	10,5	1,69	12,5	2,06	14,5	2,44	15,5	2,64	16,5	2,84	18,5	3,24	19,4	3,38
	18	10,5	1,72	12,5	2,10	14,5	2,49	15,5	2,69	16,5	2,89	18,5	3,43	19,2	3,55
	20	10,5	1,76	12,5	2,14	14,5	2,56	15,5	2,83	16,5	3,10	18,5	3,69	18,9	3,72
	21	10,5	1,77	12,5	2,16	14,5	2,66	15,5	2,93	16,5	3,21	18,4	3,78	18,8	3,81
	23	10,5	1,82	12,5	2,30	14,5	2,84	15,5	3,14	16,5	3,44	18,1	3,95	18,5	3,98
	25	10,5	1,94	12,5	2,46	14,5	3,04	15,5	3,36	16,5	3,69	17,9	4,12	18,3	4,15
	27	10,5	2,07	12,5	2,63	14,5	3,25	15,5	3,59	16,5	3,95	17,6	4,30	18,0	4,33
	29	10,5	2,21	12,5	2,80	14,5	3,47	15,5	3,84	16,5	4,22	17,4	4,47	17,7	4,51
	31	10,5	2,35	12,5	2,99	14,5	3,71	15,5	4,10	16,5	4,50	17,1	4,64	17,5	4,68
	33	10,5	2,50	12,5	3,18	14,5	3,95	15,5	4,37	16,5	4,78	16,8	4,82	17,2	4,86
	35	10,5	2,65	12,5	3,39	14,5	4,21	15,5	4,66	16,2	4,95	16,6	5,00	16,9	5,04
	37	10,5	2,82	12,5	3,60	14,5	4,49	15,5	4,97	15,9	5,13	16,3	5,17	16,7	5,22
	39	10,5	2,99	12,5	3,83	14,5	4,78	15,5	5,28	15,7	5,30	16,0	5,35	16,4	5,40

NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - Примечания - NOTLAR

1. The above table shows the average value of conditions which may occur.
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.
Yukarýdaki tablo meydana gelebilecek koþullarýn ortalama deðerini göstermektedir.

4TW33652-1

4 Capacity tables

4 - 2 Cooling Capacity Tables

RXYSQ6P8Y1

Total capacity [kW], power Input [kW] (Compressor + Outdoor fan motor)

Combination [%] (Capacity index)	Outdoor air temp. °CDB	Indoor air temp. [°CWB] 14,0 TC kW	14,0 PI kW	16,0 TC kW	16,0 PI kW	18,0 TC kW	18,0 PI kW	19,0 TC kW	19,0 PI kW	20,0 TC kW	20,0 PI kW	22,0 TC kW	22,0 PI kW	24,0 TC kW	24,0 PI kW
90%	10	9,41	1,44	11,2	1,73	13,0	2,05	14,0	2,21	14,9	2,37	16,7	2,71	18,5	3,06
14.40 kW	12	9,41	1,46	11,2	1,76	13,0	2,08	14,0	2,25	14,9	2,42	16,7	2,76	18,5	3,11
	14	9,41	1,49	11,2	1,80	13,0	2,12	14,0	2,29	14,9	2,46	16,7	2,82	18,5	3,17
	16	9,41	1,51	11,2	1,83	13,0	2,16	14,0	2,34	14,9	2,51	16,7	2,87	18,5	3,24
	18	9,41	1,54	11,2	1,86	13,0	2,21	14,0	2,38	14,9	2,56	16,7	2,93	18,5	3,42
	20	9,41	1,57	11,2	1,90	13,0	2,25	14,0	2,43	14,9	2,66	16,7	3,15	18,5	3,68
	21	9,41	1,58	11,2	1,92	13,0	2,29	14,0	2,52	14,9	2,75	16,7	3,26	18,4	3,78
	23	9,41	1,61	11,2	2,00	13,0	2,45	14,0	2,69	14,9	2,95	16,7	3,50	18,1	3,95
	25	9,41	1,70	11,2	2,13	13,0	2,62	14,0	2,88	14,9	3,16	16,7	3,74	17,9	4,12
	27	9,41	1,81	11,2	2,28	13,0	2,80	14,0	3,08	14,9	3,37	16,7	4,01	17,6	4,30
	29	9,41	1,92	11,2	2,42	13,0	2,98	14,0	3,29	14,9	3,60	16,7	4,28	17,3	4,47
	31	9,41	2,05	11,2	2,58	13,0	3,18	14,0	3,50	14,9	3,84	16,7	4,57	17,1	4,64
	33	9,41	2,17	11,2	2,75	13,0	3,39	14,0	3,74	14,9	4,10	16,5	4,78	16,8	4,82
	35	9,41	2,31	11,2	2,92	13,0	3,61	14,0	3,98	14,9	4,37	16,2	4,96	16,6	5,00
	37	9,41	2,45	11,2	3,11	13,0	3,84	14,0	4,24	14,9	4,66	16,0	5,13	16,3	5,17
	39	9,41	2,60	11,2	3,30	13,0	4,09	14,0	4,52	14,9	4,96	15,7	5,31	16,0	5,35
80%	10	8,37	1,28	10,0	1,53	11,6	1,80	12,4	1,93	13,2	2,08	14,8	2,37	16,4	2,67
12.80 kW	12	8,37	1,30	10,0	1,55	11,6	1,83	12,4	1,97	13,2	2,11	14,8	2,41	16,4	2,72
	14	8,37	1,32	10,0	1,58	11,6	1,86	12,4	2,01	13,2	2,15	14,8	2,46	16,4	2,77
	16	8,37	1,34	10,0	1,61	11,6	1,90	12,4	2,04	13,2	2,19	14,8	2,50	16,4	2,82
	18	8,37	1,36	10,0	1,64	11,6	1,93	12,4	2,08	13,2	2,24	14,8	2,55	16,4	2,88
	20	8,37	1,39	10,0	1,67	11,6	1,97	12,4	2,12	13,2	2,28	14,8	2,65	16,4	3,08
	21	8,37	1,40	10,0	1,69	11,6	1,99	12,4	2,15	13,2	2,33	14,8	2,74	16,4	3,19
	23	8,37	1,43	10,0	1,72	11,6	2,09	12,4	2,28	13,2	2,49	14,8	2,94	16,4	3,42
	25	8,37	1,47	10,0	1,83	11,6	2,23	12,4	2,44	13,2	2,66	14,8	3,14	16,4	3,66
	27	8,37	1,57	10,0	1,95	11,6	2,38	12,4	2,61	13,2	2,85	14,8	3,36	16,4	3,92
	29	8,37	1,66	10,0	2,07	11,6	2,53	12,4	2,78	13,2	3,04	14,8	3,59	16,4	4,19
	31	8,37	1,77	10,0	2,21	11,6	2,70	12,4	2,96	13,2	3,24	14,8	3,83	16,4	4,47
	33	8,37	1,87	10,0	2,35	11,6	2,87	12,4	3,15	13,2	3,45	14,8	4,09	16,4	4,77
	35	8,37	1,99	10,0	2,49	11,6	3,05	12,4	3,36	13,2	3,67	14,8	4,35	16,2	4,95
	37	8,37	2,11	10,0	2,65	11,6	3,25	12,4	3,57	13,2	3,91	14,8	4,64	15,9	5,13
	39	8,37	2,23	10,0	2,81	11,6	3,45	12,4	3,80	13,2	4,16	14,8	4,94	15,7	5,30
70%	10	7,32	1,12	8,73	1,33	10,1	1,55	10,9	1,67	11,6	1,79	13,0	2,03	14,4	2,29
11.20 kW	12	7,32	1,14	8,73	1,35	10,1	1,58	10,9	1,70	11,6	1,82	13,0	2,07	14,4	2,33
	14	7,32	1,16	8,73	1,38	10,1	1,61	10,9	1,73	11,6	1,85	13,0	2,11	14,4	2,37
	16	7,32	1,18	8,73	1,40	10,1	1,64	10,9	1,76	11,6	1,89	13,0	2,15	14,4	2,42
	18	7,32	1,19	8,73	1,42	10,1	1,67	10,9	1,79	11,6	1,92	13,0	2,19	14,4	2,47
	20	7,32	1,21	8,73	1,45	10,1	1,70	10,9	1,83	11,6	1,96	13,0	2,23	14,4	2,54
	21	7,32	1,23	8,73	1,46	10,1	1,72	10,9	1,85	11,6	1,98	13,0	2,27	14,4	2,63
	23	7,32	1,25	8,73	1,49	10,1	1,75	10,9	1,91	11,6	2,08	13,0	2,43	14,4	2,81
	25	7,32	1,27	8,73	1,55	10,1	1,87	10,9	2,04	11,6	2,22	13,0	2,60	14,4	3,01
	27	7,32	1,34	8,73	1,65	10,1	1,99	10,9	2,17	11,6	2,36	13,0	2,77	14,4	3,22
	29	7,32	1,42	8,73	1,75	10,1	2,12	10,9	2,32	11,6	2,52	13,0	2,96	14,4	3,43
	31	7,32	1,51	8,73	1,86	10,1	2,25	10,9	2,46	11,6	2,68	13,0	3,15	14,4	3,66
	33	7,32	1,60	8,73	1,98	10,1	2,40	10,9	2,62	11,6	2,86	13,0	3,36	14,4	3,91
	35	7,32	1,69	8,73	2,10	10,1	2,55	10,9	2,79	11,6	3,04	13,0	3,58	14,4	4,16
	37	7,32	1,79	8,73	2,22	10,1	2,70	10,9	2,96	11,6	3,23	13,0	3,81	14,4	4,44
	39	7,32	1,90	8,73	2,36	10,1	2,87	10,9	3,15	11,6	3,44	13,0	4,05	14,4	4,72
60%	10	6,28	0,98	7,49	1,15	8,70	1,33	9,30	1,42	9,90	1,52	11,1	1,71	12,3	1,92
9.60 kW	12	6,28	0,99	7,49	1,16	8,70	1,35	9,30	1,44	9,90	1,54	11,1	1,74	12,3	1,96
	14	6,28	1,00	7,49	1,18	8,70	1,37	9,30	1,47	9,90	1,57	11,1	1,78	12,3	1,99
	16	6,28	1,02	7,49	1,20	8,70	1,39	9,30	1,49	9,90	1,60	11,1	1,81	12,3	2,03
	18	6,28	1,03	7,49	1,22	8,70	1,42	9,30	1,52	9,90	1,63	11,1	1,84	12,3	2,07
	20	6,28	1,05	7,49	1,24	8,70	1,44	9,30	1,55	9,90	1,66	11,1	1,88	12,3	2,11
	21	6,28	1,06	7,49	1,25	8,70	1,46	9,30	1,56	9,90	1,67	11,1	1,90	12,3	2,13
	23	6,28	1,08	7,49	1,27	8,70	1,48	9,30	1,59	9,90	1,70	11,1	1,97	12,3	2,26
	25	6,28	1,09	7,49	1,30	8,70	1,54	9,30	1,67	9,90	1,81	11,1	2,10	12,3	2,42
	27	6,28	1,13	7,49	1,37	8,70	1,64	9,30	1,78	9,90	1,93	11,1	2,24	12,3	2,58
	29	6,28	1,20	7,49	1,46	8,70	1,74	9,30	1,90	9,90	2,05	11,1	2,39	12,3	2,75
	31	6,28	1,27	7,49	1,55	8,70	1,85	9,30	2,01	9,90	2,18	11,1	2,55	12,3	2,94
	33	6,28	1,35	7,49	1,64	8,70	1,97	9,30	2,14	9,90	2,32	11,1	2,71	12,3	3,13
	35	6,28	1,42	7,49	1,74	8,70	2,09	9,30	2,27	9,90	2,47	11,1	2,88	12,3	3,33
	37	6,28	1,50	7,49	1,84	8,70	2,21	9,30	2,41	9,90	2,62	11,1	3,06	12,3	3,54
	39	6,28	1,59	7,49	1,95	8,70	2,34	9,30	2,56	9,90	2,78	11,1	3,25	12,3	3,77
50%	10	5,23	0,84	6,24	0,97	7,25	1,11	7,75	1,18	8,25	1,26	9,26	1,41	10,3	1,57
8.00 kW	12	5,23	0,85	6,24	0,98	7,25	1,13	7,75	1,20	8,25	1,28	9,26	1,44	10,3	1,60
	14	5,23	0,86	6,24	1,00	7,25	1,15	7,75	1,22	8,25	1,30	9,26	1,46	10,3	1,63
	16	5,23	0,87	6,24	1,01	7,25	1,16	7,75	1,24	8,25	1,32	9,26	1,49	10,3	1,66
	18	5,23	0,88	6,24	1,03	7,25	1,18	7,75	1,26	8,25	1,34	9,26	1,51	10,3	1,69
	20	5,23	0,90	6,24	1,05	7,25	1,20	7,75	1,28	8,25	1,37	9,26	1,54	10,3	1,72
	21	5,23	0,90	6,24	1,05	7,25	1,21	7,75	1,30	8,25	1,38	9,26	1,56	10,3	1,74
	23	5,23	0,92	6,24	1,07	7,25	1,23	7,75	1,32	8,25	1,41	9,26	1,59	10,3	1,78
	25	5,23	0,93	6,24	1,09	7,25	1,26	7,75	1,35	8,25	1,45	9,26	1,67	10,3	1,90
	27	5,23	0,95	6,24	1,13	7,25	1,33	7,75	1,43	8,25	1,54	9,26	1,77	10,3	2,02
	29	5,23	1,00	6,24	1,19	7,25	1,41	7,75	1,52	8,25	1,64	9,26	1,89	10,3	2,15
	31	5,23	1,06	6,24	1,26	7,25	1,49	7,75	1,61	8,25	1,74	9,26	2,00	10,3	2,29
	33	5,23	1,12	6,24	1,34	7,25	1,58	7,75	1,71	8,25	1,84	9,26	2,13	10,3	2,44
	35	5,23	1,18	6,24	1,41	7,25	1,67	7,75	1,81	8,25	1,95	9,26	2,26	10,3	2,59
	37	5,23	1,24	6,24	1,49	7,25	1,77	7,75	1,92	8,25	2,07	9,26	2,40	10,3	2,75
	39	5,23	1,31	6,24	1,58	7,25	1,87	7,75	2,03	8,25	2,20	9,26	2,54	10,3	2,92

4TW33652-1

4 Capacity tables

4 - 3 Heating Capacity Tables

RXYSQ4P8Y1

Total capacity (kW)
Power Input (kW) (Compressor + outdoor fan motor)

Combination (%) (Capacity index)	Outdoor air temperature		Indoor air temp (°CWB)											
			16.0		18.0		19.0		20.0		22.0		24.0	
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
	°CDB	°CWB	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
110% 15.62 kW	-19.8	-20	11.5	4.23	11.5	4.36	11.4	4.49	11.4	4.56	11.4	4.63	11.4	4.76
	-18.8	-19	11.8	4.31	11.8	4.43	11.8	4.56	11.8	4.62	11.7	4.69	11.7	4.81
	-16.7	-17	12.5	4.44	12.5	4.56	12.5	4.68	12.5	4.74	12.4	4.80	12.4	4.91
	-14.7	-15	13.2	4.56	13.2	4.67	13.2	4.78	13.1	4.84	13.1	4.89	13.1	5.01
	-12.6	-13	13.9	4.66	13.9	4.77	13.9	4.88	13.8	4.93	13.8	4.98	13.6	4.98
	-10.5	-11	14.6	4.76	14.6	4.86	14.6	4.96	14.5	5.01	14.5	5.06	13.6	4.67
	-9.5	-10	15.0	4.80	14.9	4.90	14.9	5.00	14.9	5.05	14.6	4.96	13.6	4.52
	-8.5	-9.1	15.3	4.84	15.2	4.94	15.2	5.04	15.1	5.04	14.6	4.83	13.6	4.40
	-7.0	-7.6	15.8	4.90	15.8	5.00	15.6	5.03	15.1	4.82	14.6	4.62	13.6	4.22
	-5.0	-5.6	16.5	4.98	16.5	5.07	15.6	4.75	15.1	4.56	14.6	4.37	13.6	3.99
	-3.0	-3.7	17.1	5.04	16.6	4.89	15.6	4.52	15.1	4.33	14.6	4.15	13.6	3.80
	0.0	-0.7	17.6	4.89	16.6	4.53	15.6	4.19	15.1	4.02	14.6	3.85	13.6	3.53
	3.0	2.2	17.6	4.56	16.6	4.23	15.6	3.91	15.1	3.76	14.6	3.60	13.6	3.31
	5.0	4.1	17.6	4.36	16.6	4.05	15.6	3.75	15.1	3.60	14.6	3.46	13.6	3.17
	7.0	6	17.6	4.18	16.6	3.89	15.6	3.60	15.1	3.46	14.6	3.32	13.6	3.05
	9.0	7.9	17.6	4.02	16.6	3.74	15.6	3.46	15.1	3.33	14.6	3.20	13.6	2.94
	11.0	9.8	17.6	3.87	16.6	3.60	15.6	3.34	15.1	3.21	14.6	3.08	13.6	2.84
	13.0	11.8	17.6	3.72	16.6	3.47	15.6	3.22	15.1	3.09	14.6	2.97	13.6	2.74
	15.0	13.7	17.6	3.59	16.6	3.35	15.6	3.11	15.1	2.99	14.6	2.87	13.6	2.65
100% 14.20 kW	-19.8	-20	11.4	4.44	11.4	4.56	11.4	4.68	11.4	4.74	11.4	4.80	11.3	4.92
	-18.8	-19	11.8	4.51	11.8	4.62	11.7	4.74	11.7	4.80	11.7	4.85	11.7	4.97
	-16.7	-17	12.5	4.63	12.5	4.74	12.4	4.84	12.4	4.90	12.4	4.95	12.4	5.06
	-14.7	-15	13.2	4.74	13.1	4.84	13.1	4.94	13.1	4.99	13.1	5.04	12.4	4.71
	-12.6	-13	13.9	4.83	13.8	4.93	13.8	5.03	13.7	5.04	13.3	4.82	12.4	4.40
	-10.5	-11	14.6	4.92	14.5	5.01	14.2	4.93	13.7	4.72	13.3	4.52	12.4	4.13
	-9.5	-10	14.9	4.96	14.9	5.05	14.2	4.78	13.7	4.58	13.3	4.39	12.4	4.01
	-8.5	-9.1	15.2	5.00	15.1	5.04	14.2	4.65	13.7	4.46	13.3	4.27	12.4	3.91
	-7.0	-7.6	15.7	5.05	15.1	4.82	14.2	4.45	13.7	4.27	13.3	4.09	12.4	3.74
	-5.0	-5.6	16.0	4.91	15.1	4.56	14.2	4.21	13.7	4.04	13.3	3.87	12.4	3.55
	-3.0	-3.7	16.0	4.67	15.1	4.33	14.2	4.00	13.7	3.85	13.3	3.69	12.4	3.38
	0.0	-0.7	16.0	4.33	15.1	4.02	14.2	3.72	13.7	3.57	13.3	3.43	12.4	3.15
	3.0	2.2	16.0	4.04	15.1	3.76	14.2	3.48	13.7	3.34	13.3	3.21	12.4	2.95
	5.0	4.1	16.0	3.87	15.1	3.60	14.2	3.34	13.7	3.21	13.3	3.08	12.4	2.84
	7.0	6	16.0	3.72	15.1	3.46	14.2	3.21	13.7	3.09	13.3	2.97	12.4	2.73
	9.0	7.9	16.0	3.57	15.1	3.33	14.2	3.09	13.7	2.97	13.3	2.86	12.4	2.63
	11.0	9.8	16.0	3.44	15.1	3.21	14.2	2.98	13.7	2.87	13.3	2.76	12.4	2.54
	13.0	11.8	16.0	3.32	15.1	3.09	14.2	2.87	13.7	2.77	13.3	2.66	12.4	2.45
	15.0	13.7	16.0	3.20	15.1	2.99	14.2	2.78	13.7	2.68	13.3	2.57	12.4	2.38
90% 12.78 kW	-19.8	-20	11.4	4.65	11.4	4.76	11.3	4.86	11.3	4.92	11.3	4.97	11.1	4.96
	-18.8	-19	11.7	4.71	11.7	4.81	11.7	4.92	11.7	4.97	11.7	5.02	11.1	4.76
	-16.7	-17	12.4	4.82	12.4	4.92	12.4	5.01	12.4	5.06	12.0	4.84	11.1	4.42
	-14.7	-15	13.1	4.92	13.1	5.01	12.8	4.91	12.4	4.71	12.0	4.51	11.1	4.12
	-12.6	-13	13.8	5.00	13.6	4.97	12.8	4.59	12.4	4.40	12.0	4.22	11.1	3.86
	-10.5	-11	14.4	5.03	13.6	4.66	12.8	4.30	12.4	4.13	12.0	3.96	11.1	3.63
	-9.5	-10	14.4	4.87	13.6	4.52	12.8	4.18	12.4	4.01	12.0	3.84	11.1	3.52
	-8.5	-9.1	14.4	4.74	13.6	4.40	12.8	4.07	12.4	3.90	12.0	3.74	11.1	3.43
	-7.0	-7.6	14.4	4.54	13.6	4.21	12.8	3.90	12.4	3.74	12.0	3.59	11.1	3.29
	-5.0	-5.6	14.4	4.29	13.6	3.99	12.8	3.69	12.4	3.55	12.0	3.40	11.1	3.13
	-3.0	-3.7	14.4	4.08	13.6	3.80	12.8	3.52	12.4	3.38	12.0	3.25	11.1	2.98
	0.0	-0.7	14.4	3.79	13.6	3.53	12.8	3.27	12.4	3.15	12.0	3.02	11.1	2.78
	3.0	2.2	14.4	3.55	13.6	3.30	12.8	3.07	12.4	2.95	12.0	2.84	11.1	2.61
	5.0	4.1	14.4	3.40	13.6	3.17	12.8	2.95	12.4	2.84	12.0	2.73	11.1	2.51
	7.0	6	14.4	3.27	13.6	3.05	12.8	2.83	12.4	2.73	12.0	2.63	11.1	2.42
	9.0	7.9	14.4	3.15	13.6	2.94	12.8	2.73	12.4	2.63	12.0	2.53	11.1	2.34
	11.0	9.8	14.4	3.04	13.6	2.83	12.8	2.64	12.4	2.54	12.0	2.45	11.1	2.26
	13.0	11.8	14.4	2.93	13.6	2.73	12.8	2.54	12.4	2.45	12.0	2.36	11.1	2.18
	15.0	13.7	14.4	2.83	13.6	2.64	12.8	2.46	12.4	2.37	12.0	2.29	11.1	2.12
80% 11.36 kW	-19.8	-20	11.4	4.86	11.3	4.95	11.3	5.05	11.0	4.87	10.6	4.67	9.90	4.26
	-18.8	-19	11.7	4.91	11.7	5.00	11.4	4.89	11.0	4.68	10.6	4.49	9.90	4.10
	-16.7	-17	12.4	5.01	12.1	4.91	11.4	4.53	11.0	4.34	10.6	4.16	9.90	3.81
	-14.7	-15	12.8	4.93	12.1	4.57	11.4	4.22	11.0	4.05	10.6	3.88	9.90	3.56
	-12.6	-13	12.8	4.61	12.1	4.27	11.4	3.95	11.0	3.79	10.6	3.64	9.90	3.34
	-10.5	-11	12.8	4.32	12.1	4.01	11.4	3.72	11.0	3.57	10.6	3.43	9.90	3.14
	-9.5	-10	12.8	4.19	12.1	3.90	11.4	3.61	11.0	3.47	10.6	3.33	9.90	3.06
	-8.5	-9.1	12.8	4.08	12.1	3.80	11.4	3.52	11.0	3.38	10.6	3.24	9.90	2.98
	-7.0	-7.6	12.8	3.91	12.1	3.64	11.4	3.37	11.0	3.24	10.6	3.12	9.90	2.86
	-5.0	-5.6	12.8	3.71	12.1	3.45	11.4	3.20	11.0	3.08	10.6	2.96	9.90	2.72
	-3.0	-3.7	12.8	3.53	12.1	3.29	11.4	3.05	11.0	2.94	10.6	2.82	9.90	2.60
	0.0	-0.7	12.8	3.28	12.1	3.06	11.4	2.85	11.0	2.74	10.6	2.64	9.90	2.43
	3.0	2.2	12.8	3.08	12.1	2.87	11.4	2.67	11.0	2.57	10.6	2.48	9.90	2.29
	5.0	4.1	12.8	2.96	12.1	2.76	11.4	2.57	11.0	2.48	10.6	2.38	9.90	2.20
	7.0	6	12.8	2.85	12.1	2.66	11.4	2.48	11.0	2.39	10.6	2.30	9.90	2.13
	9.0	7.9	12.8	2.74	12.1	2.56	11.4	2.39	11.0	2.30	10.6	2.22	9.90	2.05
	11.0	9.8	12.8	2.65	12.1	2.48	11.4	2.31	11.0	2.23	10.6	2.15	9.90	1.99
	13.0	11.8	12.8	2.55	12.1	2.39	11.4	2.23	11.0	2.15	10.6	2.07	9.90	1.92
	15.0	13.7	12.8	2.47	12.1	2.31	11.4	2.16	11.0	2.09	10.6	2.01	9.90	1.86

NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - примечания

The above table shows the average value of conditions which may occur.
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.

4TW33622-2A (1-2)

4 Capacity tables

4 - 3 Heating Capacity Tables

RXYSQ4P8Y1

Total capacity (kW)
Power Input (kW) (Compressor + outdoor fan motor)

Combination (%) (Capacity index)	Outdoor air temperature		Indoor air temp (°CWB)											
			16.0		18.0		19.0		20.0		22.0		24.0	
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
	°CDB	°CWB	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
70% 9.94 kW	-19.8	-20	11.2	5.00	10.6	4.64	9.94	4.28	9.62	4.11	9.30	3.94	8.66	3.61
	-18.8	-19	11.2	4.81	10.6	4.46	9.94	4.12	9.62	3.95	9.30	3.79	8.66	3.47
	-16.7	-17	11.2	4.46	10.6	4.14	9.94	3.83	9.62	3.68	9.30	3.53	8.66	3.24
	-14.7	-15	11.2	4.15	10.6	3.86	9.94	3.58	9.62	3.44	9.30	3.30	8.66	3.03
	-12.6	-13	11.2	3.89	10.6	3.62	9.94	3.35	9.62	3.23	9.30	3.10	8.66	2.85
	-10.5	-11	11.2	3.66	10.6	3.41	9.94	3.16	9.62	3.04	9.30	2.92	8.66	2.69
	-9.5	-10	11.2	3.55	10.6	3.31	9.94	3.07	9.62	2.96	9.30	2.84	8.66	2.62
	-8.5	-9.1	11.2	3.46	10.6	3.23	9.94	3.00	9.62	2.88	9.30	2.77	8.66	2.55
	-7.0	-7.6	11.2	3.32	10.6	3.10	9.94	2.88	9.62	2.77	9.30	2.66	8.66	2.46
	-5.0	-5.6	11.2	3.15	10.6	2.94	9.94	2.74	9.62	2.63	9.30	2.54	8.66	2.34
	-3.0	-3.7	11.2	3.01	10.6	2.81	9.94	2.61	9.62	2.52	9.30	2.42	8.66	2.24
	0.0	-0.7	11.2	2.80	10.6	2.62	9.94	2.44	9.62	2.35	9.30	2.27	8.66	2.10
	3.0	2.2	11.2	2.63	10.6	2.46	9.94	2.30	9.62	2.22	9.30	2.14	8.66	1.98
	5.0	4.1	11.2	2.53	10.6	2.37	9.94	2.21	9.62	2.14	9.30	2.06	8.66	1.91
	7.0	6	11.2	2.44	10.6	2.29	9.94	2.14	9.62	2.06	9.30	1.99	8.66	1.84
	9.0	7.9	11.2	2.36	10.6	2.21	9.94	2.06	9.62	1.99	9.30	1.92	8.66	1.78
	11.0	9.8	11.2	2.28	10.6	2.14	9.94	2.00	9.62	1.93	9.30	1.86	8.66	1.73
	13.0	11.8	11.2	2.20	10.6	2.06	9.94	1.93	9.62	1.86	9.30	1.80	8.66	1.67
	15.0	13.7	11.2	2.13	10.6	2.00	9.94	1.87	9.62	1.81	9.30	1.75	8.66	1.62
60% 8.52 kW	-19.8	-20	9.61	4.11	9.07	3.82	8.52	3.54	8.25	3.40	7.97	3.26	7.43	3.00
	-18.8	-19	9.61	3.95	9.07	3.67	8.52	3.41	8.25	3.27	7.97	3.14	7.43	2.89
	-16.7	-17	9.61	3.67	9.07	3.42	8.52	3.17	8.25	3.05	7.97	2.93	7.43	2.70
	-14.7	-15	9.61	3.43	9.07	3.20	8.52	2.97	8.25	2.86	7.97	2.75	7.43	2.53
	-12.6	-13	9.61	3.22	9.07	3.01	8.52	2.79	8.25	2.69	7.97	2.59	7.43	2.39
	-10.5	-11	9.61	3.04	9.07	2.84	8.52	2.64	8.25	2.54	7.97	2.45	7.43	2.26
	-9.5	-10	9.61	2.95	9.07	2.76	8.52	2.57	8.25	2.47	7.97	2.38	7.43	2.20
	-8.5	-9.1	9.61	2.88	9.07	2.69	8.52	2.51	8.25	2.42	7.97	2.33	7.43	2.15
	-7.0	-7.6	9.61	2.77	9.07	2.59	8.52	2.41	8.25	2.33	7.97	2.24	7.43	2.07
	-5.0	-5.6	9.61	2.63	9.07	2.46	8.52	2.30	8.25	2.22	7.97	2.14	7.43	1.98
	-3.0	-3.7	9.61	2.52	9.07	2.36	8.52	2.20	8.25	2.12	7.97	2.04	7.43	1.90
	0.0	-0.7	9.61	2.35	9.07	2.20	8.52	2.06	8.25	1.99	7.97	1.92	7.43	1.78
	3.0	2.2	9.61	2.22	9.07	2.08	8.52	1.94	8.25	1.88	7.97	1.81	7.43	1.68
	5.0	4.1	9.61	2.13	9.07	2.00	8.52	1.87	8.25	1.81	7.97	1.75	7.43	1.63
	7.0	6	9.61	2.06	9.07	1.93	8.52	1.81	8.25	1.75	7.97	1.69	7.43	1.57
	9.0	7.9	9.61	1.99	9.07	1.87	8.52	1.75	8.25	1.69	7.97	1.64	7.43	1.52
	11.0	9.8	9.61	1.93	9.07	1.81	8.52	1.70	8.25	1.64	7.97	1.59	7.43	1.48
	13.0	11.8	9.61	1.86	9.07	1.75	8.52	1.64	8.25	1.59	7.97	1.54	7.43	1.43
	15.0	13.7	9.61	1.81	9.07	1.70	8.52	1.60	8.25	1.55	7.97	1.49	7.43	1.39
50% 7.10 kW	-19.8	-20	8.01	3.28	7.56	3.06	7.10	2.84	6.87	2.74	6.64	2.63	6.19	2.43
	-18.8	-19	8.01	3.16	7.56	2.95	7.10	2.74	6.87	2.64	6.64	2.54	6.19	2.35
	-16.7	-17	8.01	2.95	7.56	2.76	7.10	2.56	6.87	2.47	6.64	2.38	6.19	2.20
	-14.7	-15	8.01	2.77	7.56	2.58	7.10	2.41	6.87	2.32	6.64	2.24	6.19	2.07
	-12.6	-13	8.01	2.60	7.56	2.44	7.10	2.27	6.87	2.19	6.64	2.11	6.19	1.96
	-10.5	-11	8.01	2.46	7.56	2.30	7.10	2.15	6.87	2.08	6.64	2.00	6.19	1.86
	-9.5	-10	8.01	2.39	7.56	2.24	7.10	2.10	6.87	2.02	6.64	1.95	6.19	1.81
	-8.5	-9.1	8.01	2.34	7.56	2.19	7.10	2.05	6.87	1.98	6.64	1.91	6.19	1.77
	-7.0	-7.6	8.01	2.25	7.56	2.11	7.10	1.97	6.87	1.91	6.64	1.84	6.19	1.71
	-5.0	-5.6	8.01	2.15	7.56	2.01	7.10	1.88	6.87	1.82	6.64	1.76	6.19	1.63
	-3.0	-3.7	8.01	2.06	7.56	1.93	7.10	1.81	6.87	1.75	6.64	1.69	6.19	1.57
	0.0	-0.7	8.01	1.93	7.56	1.81	7.10	1.70	6.87	1.64	6.64	1.59	6.19	1.48
	3.0	2.2	8.01	1.82	7.56	1.71	7.10	1.61	6.87	1.56	6.64	1.50	6.19	1.40
	5.0	4.1	8.01	1.76	7.56	1.66	7.10	1.55	6.87	1.50	6.64	1.45	6.19	1.36
	7.0	6	8.01	1.70	7.56	1.60	7.10	1.50	6.87	1.46	6.64	1.41	6.19	1.32
	9.0	7.9	8.01	1.65	7.56	1.55	7.10	1.46	6.87	1.41	6.64	1.37	6.19	1.28
	11.0	9.8	8.01	1.59	7.56	1.50	7.10	1.41	6.87	1.37	6.64	1.33	6.19	1.24
	13.0	11.8	8.01	1.55	7.56	1.46	7.10	1.37	6.87	1.33	6.64	1.29	6.19	1.21
	15.0	13.7	8.01	1.50	7.56	1.42	7.10	1.34	6.87	1.29	6.64	1.25	6.19	1.17

NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - примечания

The above table shows the average value of conditions which may occur.
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.

4TW33652-2A (2-2)

4 Capacity tables

4 - 3 Heating Capacity Tables

RXYSQ5P8Y1

Total capacity [kW], power Input [kW] (Compressor + Outdoor fan motor)

Combination [%] (Capacity index)	Outdoor air temp.		Indoor air temp. [°CDB]											
			16.0		18.0		20.0		21.0		22.0		24.0	
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
	°CDB	°CWB	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
130%	-19.8	-20.0	11.1	3.19	11.0	3.38	11.0	3.57	11.0	3.67	11.0	3.76	10.9	3.96
20.80 kW	-18.8	-19.0	11.4	3.30	11.4	3.48	11.3	3.67	11.3	3.76	11.3	3.85	11.3	4.04
	-16.7	-17.0	12.1	3.49	12.0	3.66	12.0	3.83	12.0	3.92	11.9	4.01	11.9	4.18
	-14.7	-15.0	12.7	3.66	12.7	3.82	12.6	3.99	12.6	4.07	12.6	4.15	12.6	4.32
	-12.6	-13.0	13.4	3.81	13.3	3.97	13.3	4.12	13.3	4.20	13.3	4.28	13.2	4.44
	-10.5	-11.0	14.0	3.95	14.0	4.10	14.0	4.25	13.9	4.32	13.9	4.39	13.9	4.54
	-9.5	-10.0	14.4	4.01	14.3	4.16	14.3	4.30	14.3	4.38	14.3	4.45	14.2	4.59
	-8.5	-9.1	14.7	4.07	14.6	4.21	14.6	4.35	14.6	4.42	14.5	4.50	14.5	4.64
	-7.0	-7.6	15.2	4.15	15.1	4.29	15.1	4.43	15.1	4.50	15.0	4.57	15.0	4.71
	-5.0	-5.6	15.8	4.26	15.8	4.40	15.7	4.53	15.7	4.59	15.7	4.66	15.7	4.79
	-3.0	-3.7	16.4	4.36	16.4	4.49	16.4	4.61	16.3	4.68	16.3	4.74	16.3	4.87
	0.0	-0.7	17.4	4.49	17.4	4.61	17.3	4.73	17.3	4.79	17.3	4.85	17.3	4.97
	3.0	2.2	18.4	4.61	18.3	4.73	18.3	4.84	18.3	4.90	18.3	4.95	18.1	5.02
	5.0	4.1	19.0	4.68	19.0	4.79	18.9	4.90	18.9	4.96	18.9	5.01	18.1	4.81
	7.0	6.0	19.6	4.75	19.6	4.86	19.6	4.96	19.5	5.02	19.5	5.05	18.1	4.62
	9.0	7.9	20.3	4.81	20.2	4.92	20.2	5.02	20.1	5.06	19.5	4.85	18.1	4.44
	11.0	9.8	20.9	4.87	20.8	4.97	20.8	5.07	20.1	4.87	19.5	4.67	18.1	4.28
	13.0	11.8	21.5	4.93	21.5	5.03	20.8	4.87	20.1	4.68	19.5	4.49	18.1	4.12
	15.0	13.7	22.2	4.98	22.1	5.08	20.8	4.70	20.1	4.52	19.5	4.34	18.1	3.98
120%	-19.8	-20.0	11.0	3.45	11.0	3.63	11.0	3.80	10.9	3.89	10.9	3.98	10.9	4.15
19.20 kW	-18.8	-19.0	11.3	3.55	11.3	3.72	11.3	3.89	11.3	3.97	11.2	4.06	11.2	4.23
	-16.7	-17.0	12.0	3.72	12.0	3.88	11.9	4.04	11.9	4.12	11.9	4.20	11.9	4.37
	-14.7	-15.0	12.7	3.88	12.6	4.03	12.6	4.18	12.6	4.26	12.6	4.34	12.5	4.49
	-12.6	-13.0	13.3	4.02	13.3	4.17	13.3	4.31	13.2	4.38	13.2	4.45	13.2	4.60
	-10.5	-11.0	14.0	4.15	13.9	4.29	13.9	4.42	13.9	4.49	13.9	4.56	13.8	4.70
	-9.5	-10.0	14.3	4.21	14.3	4.34	14.2	4.48	14.2	4.54	14.2	4.61	14.2	4.75
	-8.5	-9.1	14.6	4.26	14.6	4.39	14.5	4.52	14.5	4.59	14.5	4.65	14.5	4.79
	-7.0	-7.6	15.1	4.34	15.1	4.47	15.0	4.60	15.0	4.66	15.0	4.72	15.0	4.85
	-5.0	-5.6	15.8	4.44	15.7	4.56	15.7	4.69	15.7	4.75	15.7	4.81	15.6	4.93
	-3.0	-3.7	16.4	4.53	16.4	4.65	16.3	4.76	16.3	4.82	16.3	4.88	16.3	5.00
	0.0	-0.7	17.4	4.66	17.3	4.77	17.3	4.88	17.3	4.93	17.3	4.99	16.7	4.86
	3.0	2.2	18.3	4.77	18.3	4.87	18.3	4.97	18.2	5.03	18.0	4.96	16.7	4.55
	5.0	4.1	19.0	4.83	18.9	4.93	18.9	5.03	18.6	4.96	18.0	4.76	16.7	4.36
	7.0	6.0	19.6	4.89	19.5	4.99	19.2	4.96	18.6	4.76	18.0	4.57	16.7	4.19
	9.0	7.9	20.2	4.95	20.2	5.05	19.2	4.77	18.6	4.58	18.0	4.39	16.7	4.03
	11.0	9.8	20.8	5.01	20.4	4.96	19.2	4.59	18.6	4.41	18.0	4.23	16.7	3.89
	13.0	11.8	21.5	5.06	20.4	4.77	19.2	4.42	18.6	4.25	18.0	4.08	16.7	3.74
	15.0	13.7	21.7	4.95	20.4	4.60	19.2	4.26	18.6	4.10	18.0	3.94	16.7	3.62
110%	-19.8	-20.0	11.0	3.71	10.9	3.87	10.9	4.03	10.9	4.11	10.9	4.19	10.8	4.35
17.60 kW	-18.8	-19.0	11.3	3.80	11.3	3.95	11.2	4.11	11.2	4.19	11.2	4.27	11.2	4.42
	-16.7	-17.0	12.0	3.96	11.9	4.11	11.9	4.25	11.9	4.33	11.9	4.40	11.8	4.55
	-14.7	-15.0	12.6	4.10	12.6	4.24	12.6	4.38	12.5	4.45	12.5	4.52	12.5	4.66
	-12.6	-13.0	13.3	4.23	13.2	4.36	13.2	4.50	13.2	4.56	13.2	4.63	13.2	4.76
	-10.5	-11.0	13.9	4.35	13.9	4.48	13.9	4.60	13.9	4.67	13.8	4.73	13.8	4.86
	-9.5	-10.0	14.3	4.41	14.2	4.53	14.2	4.65	14.2	4.71	14.2	4.77	14.1	4.90
	-8.5	-9.1	14.6	4.45	14.5	4.57	14.5	4.69	14.5	4.75	14.5	4.81	14.4	4.94
	-7.0	-7.6	15.1	4.53	15.0	4.64	15.0	4.76	15.0	4.82	15.0	4.88	14.9	4.99
	-5.0	-5.6	15.7	4.62	15.7	4.73	15.6	4.84	15.6	4.90	15.6	4.95	15.3	4.94
	-3.0	-3.7	16.3	4.70	16.3	4.81	16.3	4.92	16.3	4.97	16.2	5.02	15.3	4.70
	0.0	-0.7	17.3	4.82	17.3	4.92	17.3	5.02	17.0	4.97	16.5	4.77	15.3	4.37
	3.0	2.2	18.3	4.92	18.2	5.01	17.6	4.84	17.0	4.65	16.5	4.46	15.3	4.09
	5.0	4.1	18.9	4.98	18.7	5.01	17.6	4.64	17.0	4.46	16.5	4.28	15.3	3.93
	7.0	6.0	19.5	5.04	18.7	4.81	17.6	4.45	17.0	4.28	16.5	4.11	15.3	3.78
	9.0	7.9	19.9	4.97	18.7	4.62	17.6	4.29	17.0	4.12	16.5	3.96	15.3	3.64
	11.0	9.8	19.9	4.79	18.7	4.45	17.6	4.13	17.0	3.97	16.5	3.81	15.3	3.51
	13.0	11.8	19.9	4.60	18.7	4.29	17.6	3.98	17.0	3.82	16.5	3.68	15.3	3.38
	15.0	13.7	19.9	4.44	18.7	4.14	17.6	3.84	17.0	3.70	16.5	3.55	15.3	3.27
100%	-19.8	-20.0	10.9	3.97	10.9	4.11	10.9	4.26	10.9	4.33	10.8	4.41	10.8	4.55
16.00 kW	-18.8	-19.0	11.3	4.05	11.2	4.19	11.2	4.33	11.2	4.40	11.2	4.47	11.1	4.62
	-16.7	-17.0	11.9	4.19	11.9	4.33	11.9	4.46	11.8	4.53	11.8	4.60	11.8	4.73
	-14.7	-15.0	12.6	4.33	12.5	4.45	12.5	4.58	12.5	4.64	12.5	4.71	12.5	4.83
	-12.6	-13.0	13.2	4.44	13.2	4.56	13.2	4.69	13.2	4.75	13.1	4.81	13.1	4.93
	-10.5	-11.0	13.9	4.55	13.9	4.67	13.8	4.78	13.8	4.84	13.8	4.90	13.8	5.01
	-9.5	-10.0	14.2	4.60	14.2	4.71	14.2	4.83	14.1	4.88	14.1	4.94	13.9	4.96
	-8.5	-9.1	14.5	4.65	14.5	4.75	14.5	4.86	14.4	4.92	14.4	4.97	13.9	4.83
	-7.0	-7.6	15.0	4.71	15.0	4.82	14.9	4.93	14.9	4.98	14.9	5.03	13.9	4.63
	-5.0	-5.6	15.7	4.80	15.6	4.90	15.6	5.00	15.5	5.00	15.0	4.79	13.9	4.39
	-3.0	-3.7	16.3	4.87	16.3	4.97	16.0	4.95	15.5	4.76	15.0	4.56	13.9	4.18
	0.0	-0.7	17.3	4.98	17.0	4.97	16.0	4.60	15.5	4.42	15.0	4.24	13.9	3.89
	3.0	2.2	18.1	4.99	17.0	4.64	16.0	4.30	15.5	4.14	15.0	3.97	13.9	3.65
	5.0	4.1	18.1	4.79	17.0	4.45	16.0	4.13	15.5	3.97	15.0	3.81	13.9	3.51
	7.0	6.0	18.1	4.60	17.0	4.28	16.0	3.97	15.5	3.82	15.0	3.67	13.9	3.38
	9.0	7.9	18.1	4.42	17.0	4.12	16.0	3.82	15.5	3.68	15.0	3.54	13.9	3.26
	11.0	9.8	18.1	4.26	17.0	3.97	16.0	3.69	15.5	3.55	15.0	3.41	13.9	3.14
	13.0	11.8	18.1	4.10	17.0	3.82	16.0	3.55	15.5	3.42	15.0	3.29	13.9	3.03
	15.0	13.7	18.1	3.96	17.0	3.70	16.0	3.44	15.5	3.31	15.0	3.18	13.9	2.94

NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - Примечания - NOTLAR

1. The above table shows the average value of conditions which may occur.
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.
Yukarýdaki tablo meydana gelebilecek koþullarýn ortalama deðerini göstermektedir.

4TW33652-2

4 Capacity tables

4 - 3 Heating Capacity Tables

RXYSQ5P8Y1

Total capacity [kW], power Input [kW] (Compressor + Outdoor fan motor)

Combination [%] (Capacity index)	Outdoor air temp.		Indoor air temp. [°CDB] 16.0		18.0		20.0		21.0		22.0		24.0	
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
	°CDB	°CWB	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
90%	-19.8	-20.0	10.9	4.22	10.8	4.36	10.8	4.49	10.8	4.55	10.8	4.62	10.8	4.75
14.40 kW	-18.8	-19.0	11.2	4.30	11.2	4.42	11.2	4.55	11.1	4.62	11.1	4.68	11.1	4.81
	-16.7	-17.0	11.9	4.43	11.8	4.55	11.8	4.67	11.8	4.73	11.8	4.79	11.8	4.91
	-14.7	-15.0	12.5	4.55	12.5	4.66	12.5	4.78	12.5	4.83	12.4	4.89	12.4	5.01
	-12.6	-13.0	13.2	4.66	13.2	4.76	13.1	4.87	13.1	4.93	13.1	4.98	12.5	4.77
	-10.5	-11.0	13.8	4.75	13.8	4.86	13.8	4.96	13.8	5.01	13.5	4.90	12.5	4.48
	-9.5	-10.0	14.2	4.80	14.1	4.90	14.1	5.00	13.9	4.96	13.5	4.75	12.5	4.36
	-8.5	-9.1	14.5	4.84	14.4	4.94	14.4	5.03	13.9	4.83	13.5	4.63	12.5	4.25
	-7.0	-7.6	15.0	4.90	14.9	5.00	14.4	4.82	13.9	4.63	13.5	4.44	12.5	4.07
	-5.0	-5.6	15.6	4.98	15.3	4.93	14.4	4.57	13.9	4.39	13.5	4.21	12.5	3.87
	-3.0	-3.7	16.2	5.04	15.3	4.69	14.4	4.35	13.9	4.18	13.5	4.01	12.5	3.69
	0.0	-0.7	16.3	4.69	15.3	4.36	14.4	4.05	13.9	3.89	13.5	3.74	12.5	3.44
	3.0	2.2	16.3	4.39	15.3	4.08	14.4	3.79	13.9	3.65	13.5	3.51	12.5	3.23
	5.0	4.1	16.3	4.21	15.3	3.92	14.4	3.64	13.9	3.51	13.5	3.37	12.5	3.11
	7.0	6.0	16.3	4.04	15.3	3.77	14.4	3.51	13.9	3.38	13.5	3.25	12.5	3.00
	9.0	7.9	16.3	3.89	15.3	3.63	14.4	3.38	13.9	3.25	13.5	3.13	12.5	2.89
	11.0	9.8	16.3	3.75	15.3	3.50	14.4	3.26	13.9	3.14	13.5	3.02	12.5	2.79
	13.0	11.8	16.3	3.62	15.3	3.38	14.4	3.15	13.9	3.03	13.5	2.92	12.5	2.70
	15.0	13.7	16.3	3.50	15.3	3.27	14.4	3.05	13.9	2.94	13.5	2.83	12.5	2.62
80%	-19.8	-20.0	10.8	4.48	10.8	4.60	10.8	4.72	10.8	4.77	10.8	4.83	10.7	4.95
12.80 kW	-18.8	-19.0	11.2	4.55	11.1	4.66	11.1	4.77	11.1	4.83	11.1	4.89	11.1	5.00
	-16.7	-17.0	11.8	4.66	11.8	4.77	11.8	4.88	11.8	4.93	11.7	4.99	11.2	4.71
	-14.7	-15.0	12.5	4.77	12.4	4.87	12.4	4.97	12.4	5.01	12.0	4.80	11.2	4.40
	-12.6	-13.0	13.1	4.87	13.1	4.96	12.8	4.89	12.4	4.69	12.0	4.50	11.2	4.13
	-10.5	-11.0	13.8	4.95	13.6	4.96	12.8	4.60	12.4	4.41	12.0	4.24	11.2	3.89
	-9.5	-10.0	14.1	5.00	13.6	4.82	12.8	4.46	12.4	4.29	12.0	4.12	11.2	3.78
	-8.5	-9.1	14.4	5.03	13.6	4.69	12.8	4.35	12.4	4.18	12.0	4.01	11.2	3.69
	-7.0	-7.6	14.4	4.84	13.6	4.50	12.8	4.17	12.4	4.01	12.0	3.85	11.2	3.54
	-5.0	-5.6	14.4	4.58	13.6	4.27	12.8	3.96	12.4	3.81	12.0	3.66	11.2	3.37
	-3.0	-3.7	14.4	4.37	13.6	4.07	12.8	3.78	12.4	3.63	12.0	3.49	11.2	3.22
	0.0	-0.7	14.4	4.06	13.6	3.79	12.8	3.52	12.4	3.39	12.0	3.26	11.2	3.01
	3.0	2.2	14.4	3.81	13.6	3.55	12.8	3.31	12.4	3.18	12.0	3.06	11.2	2.83
	5.0	4.1	14.4	3.66	13.6	3.41	12.8	3.18	12.4	3.06	12.0	2.95	11.2	2.73
	7.0	6.0	14.4	3.52	13.6	3.29	12.8	3.06	12.4	2.95	12.0	2.84	11.2	2.63
	9.0	7.9	14.4	3.39	13.6	3.17	12.8	2.96	12.4	2.85	12.0	2.75	11.2	2.54
	11.0	9.8	14.4	3.27	13.6	3.06	12.8	2.86	12.4	2.75	12.0	2.65	11.2	2.46
	13.0	11.8	14.4	3.16	13.6	2.96	12.8	2.76	12.4	2.66	12.0	2.57	11.2	2.38
	15.0	13.7	14.4	3.06	13.6	2.86	12.8	2.67	12.4	2.58	12.0	2.49	11.2	2.31
70%	-19.8	-20.0	10.8	4.74	10.8	4.84	10.7	4.94	10.7	5.00	10.5	4.87	9.76	4.46
11.20 kW	-18.8	-19.0	11.1	4.80	11.1	4.90	11.1	5.00	10.8	4.89	10.5	4.69	9.76	4.30
	-16.7	-17.0	11.8	4.90	11.7	4.99	11.2	4.73	10.8	4.55	10.5	4.36	9.76	4.00
	-14.7	-15.0	12.4	4.99	11.9	4.77	11.2	4.42	10.8	4.25	10.5	4.08	9.76	3.75
	-12.6	-13.0	12.6	4.81	11.9	4.48	11.2	4.15	10.8	3.99	10.5	3.83	9.76	3.52
	-10.5	-11.0	12.6	4.52	11.9	4.21	11.2	3.91	10.8	3.76	10.5	3.61	9.76	3.33
	-9.5	-10.0	12.6	4.39	11.9	4.09	11.2	3.80	10.8	3.65	10.5	3.51	9.76	3.24
	-8.5	-9.1	12.6	4.28	11.9	3.99	11.2	3.71	10.8	3.57	10.5	3.43	9.76	3.16
	-7.0	-7.6	12.6	4.11	11.9	3.83	11.2	3.56	10.8	3.43	10.5	3.30	9.76	3.04
	-5.0	-5.6	12.6	3.90	11.9	3.64	11.2	3.38	10.8	3.26	10.5	3.14	9.76	2.89
	-3.0	-3.7	12.6	3.72	11.9	3.47	11.2	3.23	10.8	3.11	10.5	3.00	9.76	2.77
	0.0	-0.7	12.6	3.47	11.9	3.24	11.2	3.02	10.8	2.91	10.5	2.80	9.76	2.59
	3.0	2.2	12.6	3.26	11.9	3.05	11.2	2.84	10.8	2.74	10.5	2.64	9.76	2.45
	5.0	4.1	12.6	3.13	11.9	2.93	11.2	2.74	10.8	2.64	10.5	2.55	9.76	2.36
	7.0	6.0	12.6	3.02	11.9	2.83	11.2	2.64	10.8	2.55	10.5	2.46	9.76	2.28
	9.0	7.9	12.6	2.91	11.9	2.73	11.2	2.55	10.8	2.46	10.5	2.38	9.76	2.21
	11.0	9.8	12.6	2.82	11.9	2.64	11.2	2.47	10.8	2.38	10.5	2.30	9.76	2.14
	13.0	11.8	12.6	2.72	11.9	2.55	11.2	2.39	10.8	2.31	10.5	2.23	9.76	2.07
	15.0	13.7	12.6	2.64	11.9	2.47	11.2	2.32	10.8	2.24	10.5	2.16	9.76	2.01
60%	-19.8	-20.0	10.7	5.00	10.2	4.72	9.60	4.37	9.29	4.20	8.98	4.03	8.37	3.71
9.60 kW	-18.8	-19.0	10.8	4.89	10.2	4.54	9.60	4.21	9.29	4.05	8.98	3.89	8.37	3.58
	-16.7	-17.0	10.8	4.54	10.2	4.23	9.60	3.92	9.29	3.77	8.98	3.63	8.37	3.34
	-14.7	-15.0	10.8	4.25	10.2	3.96	9.60	3.67	9.29	3.54	8.98	3.40	8.37	3.13
	-12.6	-13.0	10.8	3.99	10.2	3.72	9.60	3.46	9.29	3.33	8.98	3.20	8.37	2.95
	-10.5	-11.0	10.8	3.76	10.2	3.51	9.60	3.26	9.29	3.14	8.98	3.03	8.37	2.79
	-9.5	-10.0	10.8	3.65	10.2	3.41	9.60	3.18	9.29	3.06	8.98	2.95	8.37	2.72
	-8.5	-9.1	10.8	3.56	10.2	3.33	9.60	3.10	9.29	2.99	8.98	2.88	8.37	2.66
	-7.0	-7.6	10.8	3.42	10.2	3.20	9.60	2.98	9.29	2.88	8.98	2.77	8.37	2.56
	-5.0	-5.6	10.8	3.26	10.2	3.05	9.60	2.84	9.29	2.74	8.98	2.64	8.37	2.44
	-3.0	-3.7	10.8	3.11	10.2	2.91	9.60	2.72	9.29	2.62	8.98	2.53	8.37	2.34
	0.0	-0.7	10.8	2.91	10.2	2.73	9.60	2.55	9.29	2.46	8.98	2.37	8.37	2.20
	3.0	2.2	10.8	2.74	10.2	2.57	9.60	2.40	9.29	2.32	8.98	2.24	8.37	2.08
	5.0	4.1	10.8	2.64	10.2	2.48	9.60	2.32	9.29	2.24	8.98	2.16	8.37	2.01
	7.0	6.0	10.8	2.55	10.2	2.39	9.60	2.24	9.29	2.17	8.98	2.09	8.37	1.95
	9.0	7.9	10.8	2.46	10.2	2.31	9.60	2.17	9.29	2.10	8.98	2.02	8.37	1.88
	11.0	9.8	10.8	2.38	10.2	2.24	9.60	2.10	9.29	2.03	8.98	1.96	8.37	1.83
	13.0	11.8	10.8	2.31	10.2	2.17	9.60	2.03	9.29	1.97	8.98	1.90	8.37	1.77
	15.0	13.7	10.8	2.24	10.2	2.10	9.60	1.98	9.29	1.91	8.98	1.85	8.37	1.72
50%	-19.8	-20.0	9.03	4.06	8.51	3.78	8.00	3.52	7.74	3.39	7.49	3.26	6.97	3.00
8.00 kW	-18.8	-19.0	9.03	3.91	8.51	3.65	8.00	3.39	7.74	3.27	7.49	3.14	6.97	2.90
	-16.7	-17.0	9.03	3.65	8.51	3.41	8.00	3.17	7.74	3.06	7.49	2.94	6.97	2.72
	-14.7	-15.0	9.03	3.42	8.51	3.20	8.00	2.98	7.74	2.87	7.49	2.77	6.97	2.56
	-12.6	-13.0	9.03	3.22	8.51	3.01	8.00	2.81	7.74	2.71	7.49	2.61	6.97	2.42
	-10.5	-11.0	9.03	3.04	8.51	2.85	8.00	2.66	7.74	2.57	7.49	2.48	6.97	2.29
	-9.5	-10.0	9.03	2.96	8.51	2.77	8.00	2.59	7.74	2.50	7.49	2.41	6.97	2.24
	-8.5	-9.1	9.03	2.89	8.51	2.71	8.00	2.53	7.74	2.45	7.49	2.36	6.97	2.19
	-7.0	-7.6	9.03	2.79	8.51	2.61	8.00	2.44	7.74	2.36	7.49	2.28	6.97	2.11
	-5.0	-5.6	9.03	2.65	8.51	2.49	8.00	2.33	7.74	2.25	7.49	2.17	6.97	2.02
	-3.0	-3.7	9.03	2.54	8.51	2.39	8.00	2.24	7.74	2.16	7.49	2.09	6.97	1.94
	0.0	-0.7	9.03	2.39	8.51	2.24	8.00	2.10	7.74	2.03	7.49	1.96	6.97	1.83
	3.0	2.2	9.03	2.25	8.51	2.12	8.00	1.99	7.74	1.92	7.49	1.86	6.97	1.73
	5.0	4.1	9.03	2.17	8.51	2.05	8.00	1.92	7.74	1.86	7.49	1.80	6.97	1.68
	7.0	6.0	9.03	2.10	8.51	1.98	8.00	1.86	7.74	1.80	7.49	1.74	6.97	1.63
	9.0	7.9	9.03	2.03	8.51	1.92	8.00	1.80	7.74	1.75	7.49	1.69	6.97	1.58
	11.0	9.8	9.03	1.97	8.51	1.86	8.00	1.75	7.74	1.69	7.49	1.64	6.97	1.53
	13.0	11.8	9.03	1.91	8.51	1.80	8.00	1.70	7.74	1.64	7.49	1.59	6.97	1.49
	15.0	13.7	9.03	1.86	8.51	1.75	8.00	1.65	7.74	1.60	7.49	1.55	6.97	1.45

4TW33652-2

4 Capacity tables

4 - 3 Heating Capacity Tables

RXYSQ6P8Y1

Total capacity [kW], power Input [kW] (Compressor + Outdoor fan motor)

Combination [%] (Capacity index)	Outdoor air temp.		Indoor air temp. [°CDB]											
			16.0		18.0		20.0		21.0		22.0		24.0	
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
	°CDB	°CWB	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
130% 23.40 kW	-19,8	-20,0	11,3	2,89	11,3	3,11	11,2	3,34	11,2	3,45	11,2	3,56	11,1	3,79
	-18,8	-19,0	11,6	3,01	11,6	3,23	11,6	3,45	11,5	3,56	11,5	3,67	11,5	3,89
	-16,7	-17,0	12,3	3,23	12,3	3,44	12,2	3,65	12,2	3,75	12,2	3,85	12,1	4,06
	-14,7	-15,0	13,0	3,43	12,9	3,63	12,9	3,82	12,9	3,92	12,8	4,02	12,8	4,22
	-12,6	-13,0	13,6	3,61	13,6	3,80	13,6	3,99	13,5	4,08	13,5	4,17	13,5	4,36
	-10,5	-11,0	14,3	3,78	14,3	3,95	14,2	4,13	14,2	4,22	14,2	4,31	14,1	4,48
	-9,5	-10,0	14,6	3,85	14,6	4,03	14,6	4,20	14,5	4,28	14,5	4,37	14,5	4,54
	-8,5	-9,1	14,9	3,92	14,9	4,09	14,9	4,26	14,8	4,34	14,8	4,43	14,8	4,59
	-7,0	-7,6	15,4	4,02	15,4	4,19	15,4	4,35	15,3	4,43	15,3	4,51	15,3	4,67
	-5,0	-5,6	16,1	4,15	16,1	4,31	16,0	4,46	16,0	4,54	16,0	4,62	15,9	4,77
	-3,0	-3,7	16,7	4,26	16,7	4,41	16,7	4,56	16,6	4,64	16,6	4,71	16,6	4,86
	0.0	-0,7	17,7	4,42	17,7	4,56	17,7	4,70	17,6	4,78	17,6	4,85	17,6	4,99
	3,0	2,2	18,7	4,56	18,7	4,69	18,6	4,83	18,6	4,90	18,6	4,96	18,5	5,10
	5,0	4,1	19,3	4,64	19,3	4,77	19,3	4,90	19,2	4,97	19,2	5,03	19,2	5,16
	7,0	6,0	20,0	4,72	19,9	4,85	19,9	4,97	19,9	5,04	19,9	5,10	19,8	5,22
	9,0	7,9	20,6	4,80	20,6	4,92	20,5	5,04	20,5	5,10	20,5	5,16	20,4	5,26
	11,0	9,8	21,2	4,87	21,2	4,98	21,2	5,10	21,1	5,16	21,1	5,22	20,4	5,07
	13,0	11,8	21,9	4,94	21,9	5,05	21,8	5,16	21,8	5,22	21,8	5,28	20,4	4,88
	15,0	13,7	22,6	5,00	22,5	5,11	22,5	5,22	22,4	5,27	21,9	5,13	20,4	4,71
120% 21.60 kW	-19,8	-20,0	11,2	3,19	11,2	3,40	11,2	3,61	11,1	3,71	11,1	3,82	11,1	4,03
	-18,8	-19,0	11,6	3,30	11,5	3,51	11,5	3,71	11,5	3,81	11,5	3,91	11,4	4,11
	-16,7	-17,0	12,2	3,51	12,2	3,70	12,2	3,89	12,2	3,99	12,1	4,08	12,1	4,28
	-14,7	-15,0	12,9	3,70	12,9	3,88	12,8	4,06	12,8	4,15	12,8	4,24	12,8	4,42
	-12,6	-13,0	13,6	3,86	13,5	4,04	13,5	4,21	13,5	4,29	13,5	4,38	13,4	4,55
	-10,5	-11,0	14,2	4,02	14,2	4,18	14,2	4,34	14,2	4,42	14,1	4,50	14,1	4,67
	-9,5	-10,0	14,6	4,09	14,5	4,25	14,5	4,40	14,5	4,48	14,5	4,56	14,4	4,72
	-8,5	-9,1	14,9	4,15	14,8	4,30	14,8	4,46	14,8	4,54	14,8	4,61	14,7	4,77
	-7,0	-7,6	15,4	4,24	15,3	4,39	15,3	4,54	15,3	4,62	15,3	4,69	15,2	4,84
	-5,0	-5,6	16,1	4,36	16,0	4,50	16,0	4,65	16,0	4,72	15,9	4,79	15,9	4,94
	-3,0	-3,7	16,7	4,46	16,6	4,60	16,6	4,74	16,6	4,81	16,6	4,88	16,5	5,02
	0.0	-0,7	17,7	4,61	17,7	4,74	17,6	4,87	17,6	4,94	17,6	5,00	17,5	5,14
	3,0	2,2	18,7	4,74	18,6	4,87	18,6	4,99	18,6	5,05	18,5	5,11	18,5	5,24
	5,0	4,1	19,3	4,82	19,3	4,94	19,2	5,06	19,2	5,12	19,2	5,18	18,8	5,16
	7,0	6,0	19,9	4,89	19,9	5,01	19,8	5,12	19,8	5,18	19,8	5,24	18,8	4,96
	9,0	7,9	20,6	4,96	20,5	5,07	20,5	5,18	20,5	5,24	20,2	5,20	18,8	4,77
	11,0	9,8	21,2	5,03	21,2	5,13	21,1	5,24	20,9	5,22	20,2	5,01	18,8	4,60
	13,0	11,8	21,9	5,09	21,8	5,19	21,6	5,23	20,9	5,03	20,2	4,83	18,8	4,43
	15,0	13,7	22,5	5,15	22,5	5,25	21,6	5,05	20,9	4,85	20,2	4,66	18,8	4,29
110% 19.80 kW	-19,8	-20,0	11,2	3,50	11,2	3,69	11,1	3,88	11,1	3,97	11,1	4,07	11,0	4,26
	-18,8	-19,0	11,5	3,60	11,5	3,79	11,5	3,97	11,4	4,06	11,4	4,16	11,4	4,34
	-16,7	-17,0	12,2	3,79	12,2	3,97	12,1	4,14	12,1	4,23	12,1	4,32	12,1	4,49
	-14,7	-15,0	12,9	3,96	12,8	4,13	12,8	4,29	12,8	4,38	12,8	4,46	12,7	4,62
	-12,6	-13,0	13,5	4,12	13,5	4,27	13,5	4,43	13,4	4,51	13,4	4,59	13,4	4,74
	-10,5	-11,0	14,2	4,25	14,2	4,40	14,1	4,55	14,1	4,63	14,1	4,70	14,1	4,85
	-9,5	-10,0	14,5	4,32	14,5	4,47	14,5	4,61	14,4	4,68	14,4	4,76	14,4	4,90
	-8,5	-9,1	14,8	4,37	14,8	4,52	14,8	4,66	14,7	4,73	14,7	4,80	14,7	4,95
	-7,0	-7,6	15,3	4,46	15,3	4,60	15,3	4,74	15,2	4,81	15,2	4,88	15,2	5,02
	-5,0	-5,6	16,0	4,57	16,0	4,70	15,9	4,84	15,9	4,90	15,9	4,97	15,9	5,10
	-3,0	-3,7	16,6	4,67	16,6	4,79	16,6	4,92	16,5	4,98	16,5	5,05	16,5	5,18
	0.0	-0,7	17,6	4,80	17,6	4,92	17,6	5,04	17,5	5,10	17,5	5,16	17,3	5,17
	3,0	2,2	18,6	4,92	18,6	5,04	18,5	5,15	18,5	5,21	18,5	5,26	17,3	4,84
	5,0	4,1	19,2	4,99	19,2	5,10	19,2	5,21	19,1	5,27	18,5	5,06	17,3	4,65
	7,0	6,0	19,9	5,06	19,8	5,17	19,8	5,27	19,2	5,07	18,5	4,87	17,3	4,47
	9,0	7,9	20,5	5,12	20,5	5,23	19,8	5,07	19,2	4,88	18,5	4,68	17,3	4,31
	11,0	9,8	21,1	5,18	21,1	5,27	19,8	4,89	19,2	4,70	18,5	4,52	17,3	4,15
	13,0	11,8	21,8	5,24	21,1	5,07	19,8	4,71	19,2	4,53	18,5	4,35	17,3	4,01
	15,0	13,7	22,3	5,26	21,1	4,90	19,8	4,55	19,2	4,38	18,5	4,21	17,3	3,87
100% 18.00 kW	-19,8	-20,0	11,1	3,80	11,1	3,98	11,1	4,15	11,1	4,24	11,0	4,32	11,0	4,50
	-18,8	-19,0	11,5	3,90	11,4	4,07	11,4	4,23	11,4	4,32	11,4	4,40	11,3	4,57
	-16,7	-17,0	12,1	4,07	12,1	4,23	12,1	4,39	12,1	4,47	12,0	4,55	12,0	4,71
	-14,7	-15,0	12,8	4,23	12,8	4,38	12,7	4,53	12,7	4,60	12,7	4,68	12,7	4,83
	-12,6	-13,0	13,5	4,37	13,4	4,51	13,4	4,65	13,4	4,72	13,4	4,79	13,3	4,94
	-10,5	-11,0	14,1	4,49	14,1	4,63	14,1	4,76	14,1	4,83	14,0	4,90	14,0	5,04
	-9,5	-10,0	14,5	4,55	14,4	4,68	14,4	4,82	14,4	4,88	14,4	4,95	14,3	5,08
	-8,5	-9,1	14,8	4,60	14,7	4,73	14,7	4,86	14,7	4,93	14,7	4,99	14,6	5,12
	-7,0	-7,6	15,3	4,68	15,2	4,81	15,2	4,93	15,2	5,00	15,2	5,06	15,1	5,19
	-5,0	-5,6	15,9	4,78	15,9	4,90	15,9	5,02	15,9	5,08	15,8	5,14	15,7	5,20
	-3,0	-3,7	16,6	4,87	16,5	4,99	16,5	5,10	16,5	5,16	16,5	5,22	15,7	4,95
	0.0	-0,7	17,6	5,00	17,5	5,10	17,5	5,21	17,4	5,23	16,8	5,02	15,7	4,61
	3,0	2,2	18,5	5,10	18,5	5,21	18,0	5,09	17,4	4,90	16,8	4,70	15,7	4,32
	5,0	4,1	19,2	5,17	19,1	5,27	18,0	4,89	17,4	4,70	16,8	4,52	15,7	4,15
	7,0	6,0	19,8	5,23	19,2	5,07	18,0	4,70	17,4	4,52	16,8	4,34	15,7	4,00
	9,0	7,9	20,3	5,23	19,2	4,87	18,0	4,53	17,4	4,35	16,8	4,19	15,7	3,86
	11,0	9,8	20,3	5,04	19,2	4,70	18,0	4,36	17,4	4,20	16,8	4,04	15,7	3,72
	13,0	11,8	20,3	4,85	19,2	4,53	18,0	4,21	17,4	4,05	16,8	3,90	15,7	3,59
	15,0	13,7	20,3	4,69	19,2	4,37	18,0	4,07	17,4	3,92	16,8	3,77	15,7	3,48

NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - Примечания - NOTLAR

1. The above table shows the average value of conditions which may occur.
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.
Yukarýdaki tablo meydana gelebilecek koþullarýn ortalama deðerini göstermektedir.

4TW33652-2

4 Capacity tables

4 - 3 Heating Capacity Tables

RXYSQ6P8Y1

Total capacity [kW], power Input [kW] (Compressor + Outdoor fan motor)

Combination [%] (Capacity index)	Outdoor air temp.		Indoor air temp. [°CDB] 16.0		18.0		20.0		21.0		22.0		24.0	
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
	°CDB	°CWB	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
90% 16.20 kW	-19,8	-20,0	11,1	4,11	11,0	4,26	11,0	4,42	11,0	4,50	11,0	4,58	11,0	4,73
	-18,8	-19,0	11,4	4,19	11,4	4,34	11,4	4,50	11,3	4,57	11,3	4,65	11,3	4,80
	-16,7	-17,0	12,1	4,35	12,1	4,49	12,0	4,64	12,0	4,71	12,0	4,78	12,0	4,92
	-14,7	-15,0	12,7	4,49	12,7	4,63	12,7	4,76	12,7	4,83	12,7	4,90	12,6	5,03
	-12,6	-13,0	13,4	4,62	13,4	4,75	13,4	4,87	13,3	4,94	13,3	5,00	13,3	5,13
	-10,5	-11,0	14,1	4,73	14,1	4,85	14,0	4,98	14,0	5,04	14,0	5,10	14,0	5,22
	-9,5	-10,0	14,4	4,79	14,4	4,90	14,4	5,02	14,3	5,08	14,3	5,14	14,1	5,16
	-8,5	-9,1	14,7	4,83	14,7	4,95	14,7	5,06	14,6	5,12	14,6	5,18	14,1	5,03
	-7,0	-7,6	15,2	4,90	15,2	5,02	15,2	5,13	15,1	5,19	15,1	5,24	14,1	4,82
	-5,0	-5,6	15,9	4,99	15,9	5,10	15,8	5,21	15,7	5,19	15,2	4,98	14,1	4,58
	-3,0	-3,7	16,5	5,07	16,5	5,18	16,2	5,15	15,7	4,95	15,2	4,75	14,1	4,37
	0.0	-0,7	17,5	5,19	17,2	5,17	16,2	4,79	15,7	4,61	15,2	4,43	14,1	4,07
	3,0	2,2	18,3	5,19	17,2	4,84	16,2	4,49	15,7	4,32	15,2	4,15	14,1	3,83
	5,0	4,1	18,3	4,98	17,2	4,64	16,2	4,31	15,7	4,15	15,2	3,99	14,1	3,68
	7,0	6,0	18,3	4,79	17,2	4,47	16,2	4,15	15,7	4,00	15,2	3,84	14,1	3,55
	9,0	7,9	18,3	4,61	17,2	4,30	16,2	4,00	15,7	3,85	15,2	3,71	14,1	3,42
	11,0	9,8	18,3	4,44	17,2	4,15	16,2	3,86	15,7	3,72	15,2	3,58	14,1	3,31
	13,0	11,8	18,3	4,28	17,2	4,00	16,2	3,73	15,7	3,59	15,2	3,46	14,1	3,20
	15,0	13,7	18,3	4,14	17,2	3,87	16,2	3,61	15,7	3,48	15,2	3,35	14,1	3,10
80% 14.40 kW	-19,8	-20,0	11,0	4,41	11,0	4,55	11,0	4,69	11,0	4,76	10,9	4,83	10,9	4,97
	-18,8	-19,0	11,4	4,49	11,3	4,62	11,3	4,76	11,3	4,83	11,3	4,89	11,3	5,03
	-16,7	-17,0	12,0	4,63	12,0	4,76	12,0	4,88	12,0	4,95	11,9	5,01	11,9	5,14
	-14,7	-15,0	12,7	4,75	12,7	4,87	12,6	5,00	12,6	5,06	12,6	5,12	12,5	5,21
	-12,6	-13,0	13,4	4,87	13,3	4,98	13,3	5,10	13,3	5,15	13,3	5,21	12,5	4,89
	-10,5	-11,0	14,0	4,97	14,0	5,08	14,0	5,19	13,9	5,23	13,5	5,02	12,5	4,60
	-9,5	-10,0	14,4	5,02	14,3	5,12	14,3	5,23	13,9	5,08	13,5	4,87	12,5	4,48
	-8,5	-9,1	14,7	5,06	14,6	5,16	14,4	5,15	13,9	4,95	13,5	4,75	12,5	4,37
	-7,0	-7,6	15,2	5,12	15,1	5,22	14,4	4,94	13,9	4,75	13,5	4,56	12,5	4,19
	-5,0	-5,6	15,8	5,20	15,3	5,05	14,4	4,69	13,9	4,51	13,5	4,33	12,5	3,99
	-3,0	-3,7	16,3	5,17	15,3	4,81	14,4	4,47	13,9	4,30	13,5	4,13	12,5	3,81
	0.0	-0,7	16,3	4,81	15,3	4,48	14,4	4,17	13,9	4,01	13,5	3,86	12,5	3,56
	3,0	2,2	16,3	4,51	15,3	4,21	14,4	3,91	13,9	3,77	13,5	3,63	12,5	3,35
	5,0	4,1	16,3	4,33	15,3	4,04	14,4	3,76	13,9	3,63	13,5	3,49	12,5	3,23
	7,0	6,0	16,3	4,17	15,3	3,89	14,4	3,63	13,9	3,50	13,5	3,37	12,5	3,11
	9,0	7,9	16,3	4,01	15,3	3,75	14,4	3,50	13,9	3,37	13,5	3,25	12,5	3,01
	11,0	9,8	16,3	3,88	15,3	3,63	14,4	3,38	13,9	3,26	13,5	3,14	12,5	2,91
	13,0	11,8	16,3	3,74	15,3	3,50	14,4	3,27	13,9	3,15	13,5	3,04	12,5	2,81
	15,0	13,7	16,3	3,62	15,3	3,39	14,4	3,16	13,9	3,05	13,5	2,94	12,5	2,73
70% 12.60 kW	-19,8	-20,0	11,0	4,72	10,9	4,84	10,9	4,96	10,9	5,02	10,9	5,08	10,9	5,20
	-18,8	-19,0	11,3	4,78	11,3	4,90	11,3	5,02	11,2	5,08	11,2	5,14	11,0	5,09
	-16,7	-17,0	12,0	4,91	11,9	5,02	11,9	5,13	11,9	5,19	11,8	5,17	11,0	4,74
	-14,7	-15,0	12,6	5,02	12,6	5,12	12,6	5,23	12,2	5,03	11,8	4,83	11,0	4,44
	-12,6	-13,0	13,3	5,12	13,3	5,22	12,6	4,91	12,2	4,72	11,8	4,54	11,0	4,17
	-10,5	-11,0	14,0	5,21	13,4	4,99	12,6	4,63	12,2	4,45	11,8	4,28	11,0	3,94
	-9,5	-10,0	14,2	5,20	13,4	4,84	12,6	4,50	12,2	4,33	11,8	4,16	11,0	3,83
	-8,5	-9,1	14,2	5,07	13,4	4,72	12,6	4,39	12,2	4,22	11,8	4,06	11,0	3,74
	-7,0	-7,6	14,2	4,86	13,4	4,53	12,6	4,21	12,2	4,06	11,8	3,90	11,0	3,60
	-5,0	-5,6	14,2	4,62	13,4	4,31	12,6	4,01	12,2	3,86	11,8	3,71	11,0	3,43
	-3,0	-3,7	14,2	4,40	13,4	4,11	12,6	3,83	12,2	3,69	11,8	3,55	11,0	3,28
	0.0	-0,7	14,2	4,11	13,4	3,84	12,6	3,58	12,2	3,45	11,8	3,32	11,0	3,07
	3,0	2,2	14,2	3,86	13,4	3,61	12,6	3,37	12,2	3,25	11,8	3,13	11,0	2,90
	5,0	4,1	14,2	3,71	13,4	3,47	12,6	3,24	12,2	3,13	11,8	3,01	11,0	2,79
	7,0	6,0	14,2	3,57	13,4	3,35	12,6	3,13	12,2	3,02	11,8	2,91	11,0	2,70
	9,0	7,9	14,2	3,45	13,4	3,23	12,6	3,02	12,2	2,92	11,8	2,81	11,0	2,61
	11,0	9,8	14,2	3,33	13,4	3,13	12,6	2,92	12,2	2,82	11,8	2,72	11,0	2,53
	13,0	11,8	14,2	3,22	13,4	3,02	12,6	2,83	12,2	2,73	11,8	2,64	11,0	2,45
	15,0	13,7	14,2	3,12	13,4	2,93	12,6	2,74	12,2	2,65	11,8	2,56	11,0	2,38
60% 10.80 kW	-19,8	-20,0	10,9	5,02	10,9	5,13	10,8	5,18	10,5	4,97	10,1	4,78	9,41	4,39
	-18,8	-19,0	11,2	5,08	11,2	5,18	10,8	4,99	10,5	4,79	10,1	4,60	9,41	4,23
	-16,7	-17,0	11,9	5,19	11,5	5,01	10,8	4,65	10,5	4,47	10,1	4,29	9,41	3,95
	-14,7	-15,0	12,2	5,03	11,5	4,68	10,8	4,35	10,5	4,19	10,1	4,03	9,41	3,71
	-12,6	-13,0	12,2	4,72	11,5	4,40	10,8	4,09	10,5	3,94	10,1	3,79	9,41	3,50
	-10,5	-11,0	12,2	4,45	11,5	4,15	10,8	3,86	10,5	3,72	10,1	3,58	9,41	3,31
	-9,5	-10,0	12,2	4,32	11,5	4,04	10,8	3,76	10,5	3,62	10,1	3,49	9,41	3,22
	-8,5	-9,1	12,2	4,22	11,5	3,94	10,8	3,67	10,5	3,54	10,1	3,41	9,41	3,15
	-7,0	-7,6	12,2	4,05	11,5	3,79	10,8	3,53	10,5	3,40	10,1	3,28	9,41	3,03
	-5,0	-5,6	12,2	3,85	11,5	3,61	10,8	3,36	10,5	3,24	10,1	3,13	9,41	2,89
	-3,0	-3,7	12,2	3,68	11,5	3,45	10,8	3,22	10,5	3,11	10,1	2,99	9,41	2,77
	0.0	-0,7	12,2	3,45	11,5	3,23	10,8	3,02	10,5	2,91	10,1	2,81	9,41	2,61
	3,0	2,2	12,2	3,24	11,5	3,04	10,8	2,85	10,5	2,75	10,1	2,65	9,41	2,46
	5,0	4,1	12,2	3,13	11,5	2,93	10,8	2,74	10,5	2,65	10,1	2,56	9,41	2,38
	7,0	6,0	12,2	3,02	11,5	2,83	10,8	2,65	10,5	2,56	10,1	2,48	9,41	2,30
	9,0	7,9	12,2	2,91	11,5	2,74	10,8	2,57	10,5	2,48	10,1	2,40	9,41	2,23
	11,0	9,8	12,2	2,82	11,5	2,65	10,8	2,49	10,5	2,40	10,1	2,32	9,41	2,16
	13,0	11,8	12,2	2,73	11,5	2,57	10,8	2,41	10,5	2,33	10,1	2,25	9,41	2,10
	15,0	13,7	12,2	2,65	11,5	2,49	10,8	2,34	10,5	2,26	10,1	2,19	9,41	2,04
50% 9.00 kW	-19,8	-20,0	10,2	4,80	9,58	4,48	9,00	4,16	8,71	4,01	8,42	3,86	7,84	3,56
	-18,8	-19,0	10,2	4,63	9,58	4,32	9,00	4,02	8,71	3,87	8,42	3,72	7,84	3,44
	-16,7	-17,0	10,2	4,32	9,58	4,03	9,00	3,76	8,71	3,62	8,42	3,48	7,84	3,22
	-14,7	-15,0	10,2	4,05	9,58	3,78	9,00	3,53	8,71	3,40	8,42	3,28	7,84	3,03
	-12,6	-13,0	10,2	3,81	9,58	3,57	9,00	3,33	8,71	3,21	8,42	3,09	7,84	2,86
	-10,5	-11,0	10,2	3,60	9,58	3,37	9,00	3,15	8,71	3,04	8,42	2,93	7,84	2,72
	-9,5	-10,0	10,2	3,51	9,58	3,28	9,00	3,07	8,71	2,96	8,42	2,86	7,84	2,65
	-8,5	-9,1	10,2	3,43	9,58	3,21	9,00	3,00	8,71	2,90	8,42	2,79	7,84	2,59
	-7,0	-7,6	10,2	3,30	9,58	3,09	9,00	2,89	8,71	2,79	8,42	2,69	7,84	2,50
	-5,0	-5,6	10,2	3,14	9,58	2,95	9,00	2,76	8,71	2,67	8,42	2,57	7,84	2,39
	-3,0	-3,7	10,2	3,01	9,58	2,83	9,00	2,65	8,71	2,56	8,42	2,47	7,84	2,30
	0.0	-0,7	10,2	2,82	9,58	2,65	9,00	2,49	8,71	2,41	8,42	2,33	7,84	2,17
	3,0	2,2	10,2	2,67	9,58	2,51	9,00	2,35	8,71	2,28	8,42	2,20	7,84	2,05
	5,0	4,1	10,2	2,57	9,58	2,42	9,00	2,28	8,71	2,20	8,42	2,13	7,84	1,99
	7,0	6,0	10,2	2,49	9,58	2,34	9,00	2,20	8,71	2,13	8,42	2,06	7,84	1,93
	9,0	7,9	10,2	2,41	9,58	2,27	9,00	2,13	8,71	2,07	8,42	2,00	7,84	1,87
	11,0	9,8	10,2	2,34	9,58	2,20	9,00	2,07	8,71	2,01	8,42	1,94	7,84	1,82
	13,0	11,8	10,2	2,26	9,58	2,14	9,00	2,01	8,71	1,95	8,42	1,89	7,84	1,76
	15,0	13,7	10,2	2,20	9,58	2,08	9,00	1,95	8,71	1,89	8,42	1,84	7,84	1,72

4TW33652-2

4 Capacity tables

4 - 4 Integrated Heating Capacity Correction Factor

RXYSQ-P8Y1

INTEGRATED HEATING CAPACITY COEFFICIENT

The heating capacity tables do not take account of the reduction in capacity, when frost has accumulated or while the defrosting operation is in progress.
The capacity values, which take these factors into account, in other words, the integrated heating capacity values, can be calculated as follows:

Formula:
Integrated heating capacity = A
Value given in table of capacity characteristics = B
Integrating correction factor for frost accumulation (kW) = C
A = B x C

Correction factor for finding integrated heating capacity.

Inlet port temperature of heat exchanger (°C/RH 85%)	-7	-5	-3	0	3	5	7
Integrating correction factor for frost accumulation	0,88	0,86	0,8	0,75	0,76	0,82	1.0

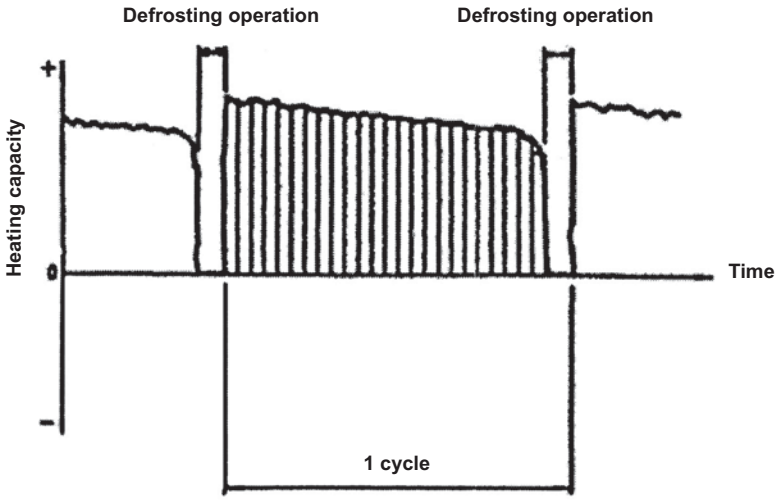

3TW30402

NOTES

1. The figure shows that the integrated heating capacity expresses the integrated capacity for a single cycle (from defrost operation to defrost operation) in terms or time.
2. Whe there is an accumulation of snow against the outside surface of the outdoor unit heat exchanger, ther will always be a temporary reduction in capacity, although this will of course vary in degree in accordance with a number of other factors, such as the outdoor temperature (°CDB), relative huminity (RH) and the amount of frosting which occurs.

4 Capacity tables

4 - 5 Capacity Correction Factor

RXYSQ-P8Y1 - for combination with RA and Sky Air indoor units

Capacity Correction Factor by the Length of Refrigerant Piping

- Rate of Change in Capacity by the Main Piping Length

Rate of Change in Cooling Capacity

Main Piping Length	5	10	15	20	25	30	35	40	45	50	55
Rate of Change in Cooling Capacity	100.0%	98.6%	97.2%	95.9%	94.7%	93.5%	92.3%	91.2%	90.1%	89.1%	88.1%

Rate of Change in Heating Capacity

Main Piping Length	5	10	15	20	25	30	35	40	45	50	55
Rate of Change in Heating Capacity	100.0%	99.5%	99.1%	98.6%	98.2%	97.7%	97.3%	96.9%	96.4%	96.0%	95.6%

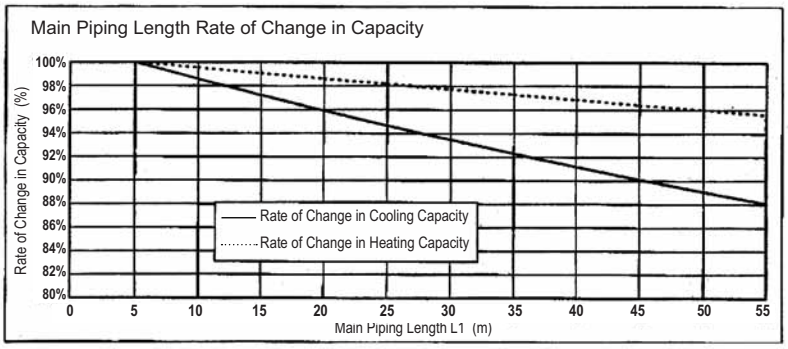

Both cases outdoor unit in inferior or superior for indoor unit, the rate of change in capacity is same

- Rate of Change in Capacity by Branch Piping Length

(1) Refrigerant Piping Connection Diameter
liquid ø 6.4
gas ø 15.9

	Rate of Change in Capacity	
piping length	Cooling	Heating
3	100.0%	100.0%
5	99.6%	99.9%
10	98.7%	99.6%
15	97.9%	99.3%

(2) Refrigerant Piping Connection Diameter
liquid ø 6.4
gas ø 12.7

	Rate of Change in Capacity	
piping length	Cooling	Heating
3	100.0%	100.0%
5	99.1%	99.5%
10	96.9%	98.2%
15	94.8%	97.0%

(3) Refrigerant Piping Connection Diameter
liquid ø 6.4
gas ø 9.5

	Rate of Change in Capacity	
piping length	Cooling	Heating
3	100.0%	100.0%
5	98.0%	98.8%
10	93.4%	96.0%
15	89.3%	93.5%

Piping size for field connection (mm)

		RA		SA	
		Liquid	Gas	Liquid	Gas
Class (KW)	25	ø 6.4	ø 9.5	ø 6.4	ø 9.5
	35				
	42				
	50		ø 12.7	ø 6.4	ø 12.7
	60				
	71				

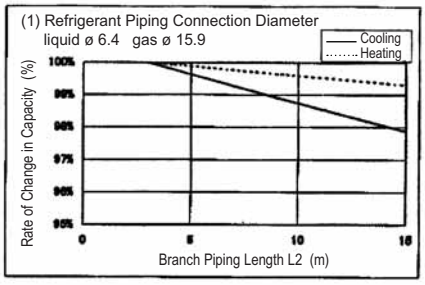
(1) Refrigerant Piping Connection Diameter
liquid ø 6.4 gas ø 15.9
Cooling
Heating
Rate of Change in Capacity (%)
Branch Piping Length L2 (m)

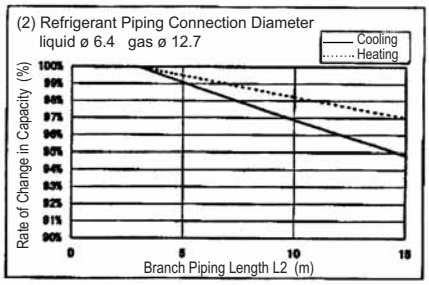
(2) Refrigerant Piping Connection Diameter
liquid ø 6.4 gas ø 12.7
Cooling
Heating
Rate of Change in Capacity (%)
Branch Piping Length L2 (m)

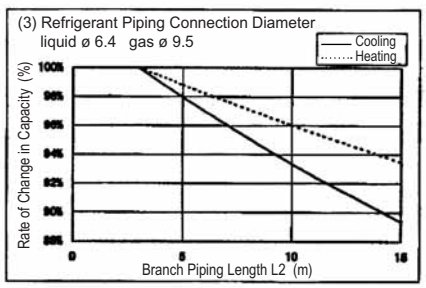
(3) Refrigerant Piping Connection Diameter
liquid ø 6.4 gas ø 9.5
Cooling
Heating
Rate of Change in Capacity (%)
Branch Piping Length L2 (m)

[Method of calculating cooling/heating capacity]
Total capacity from capacity tables x (Rate of change in capacity by main piping length x Rate of change in capacity by branch piping length)

3TW33622-5

NOTES

1. These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions.
   Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
2. With the outdoor unit, evaporating pressure constant control when cooling and condensing pressure constant control when heating is carried out.
3. For RXYSQ: use these correction factors in case of installation with bp unit.

[System layout of piping] Piping length: L1=5m L2=3m

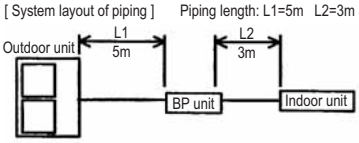

4 Capacity tables

4 - 5 Capacity Correction Factor

RXYSQ4,5P8Y1

1. Rate of change in cooling capacity

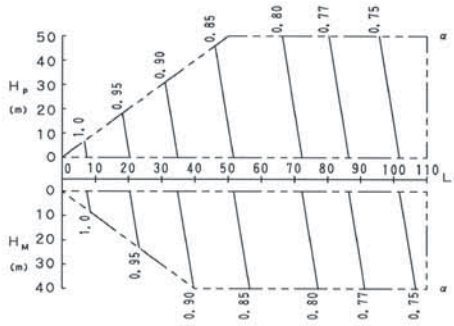

2. Rate of change in heating capacity

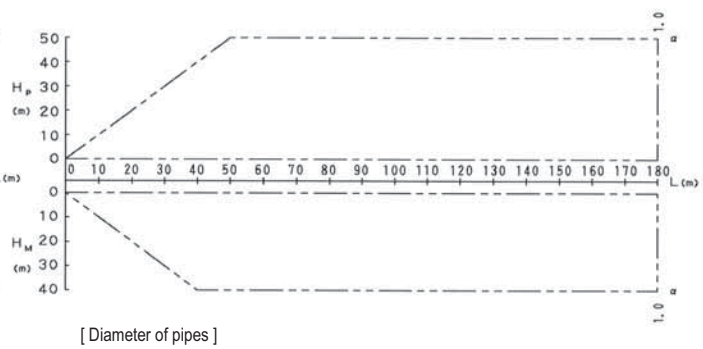

[Explanation of symbols]

Hp: Level difference (m) between indoor and outdoor units where indoor unit in inferior position

Hm: Level difference (m) between indoor and outdoor units where indoor unit in superior position

L: Equivalent pipe length (m)

α: Capacity correction factor

[Diameter of pipes]

Model	Gas	Liquid
RXYSQ4, 5P8V1 RXYSQ4, 5P8Y1	ø 15.9	ø 9.5

3TW33622-3

NOTES

1. These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
2. With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
3. Method of calculating cooling/heating capacity (max. capacity for combination with standard indoor unit)

   cooling / heating capacity = cooling / heating capacity obtained from performance characteristics table x each capacity rate of change

   In the case lenght of piping differs depending on the indoor unit, maximum capacity of aech unit during simultaneous operation is:

   cooling / heating capacity = cooling / heating capacity of each unit x capacity rate of change for each piping length

   <As for RXYSQ4, 5P8V1 - RXYSQ4, 5P8Y1>
4. When overall equivalent pipe length is 90m or more, the diameter of the main gas pipes (outdoor unit-branch sections) must be increased.

   [Diameter of above case]

Model	Gas	Liquid
RXYSQ4, 5P8V1 RXYSQ4, 5P8Y1	ø 19.1	Not increased

5. When the main sections of the interunit gas pip diameters are increased the overall equivalent length should be calculated as follows.

   Overall equivalent length = Equivalent length to main pipe x 0,5 + Equivalent length after branching

   Example: (RXYSQ4, 5P8V1 / RXYSQ4, 5P8Y1)



   In the above case (Cooling)
   Overall equivalent length = 80m x 0.5 + 40m = 80m
   The correction factor in capacity when Hp = 0m is thus approximately 0.78
6. For RXYSQ: use these correction factors in case of vrv indoor unit.

4 Capacity tables

4 - 5 Capacity Correction Factor

RXYSQ6P8Y1

1. Rate of change in cooling capacity

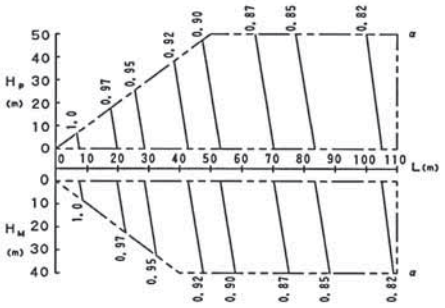

2. Rate of change in heating capacity

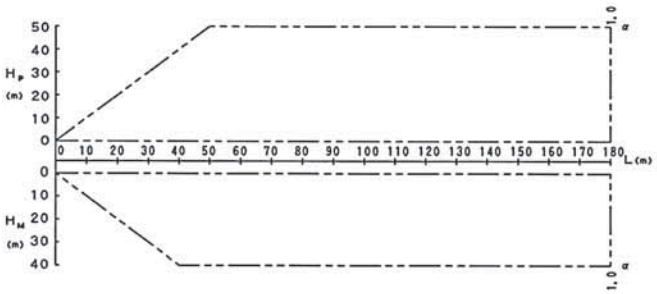

[Explanation of symbols]
Hp: Level difference (m) between indoor and outdoor units where indoor unit in inferior position
Hm: Level difference (m) between indoor and outdoor units where indoor unit in superior position
L: Equivalent pipe length (m)
α: Capacity correction factor

[Diameter of pipes]

Model	Gas	Liquid
RXYSQ6P8Y1	ø 19.1	ø 9.5

3TW33642-4

NOTES

1. These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
2. With this outdoor unit, evaporating pressure constant control when cooling, and condensing pressure constant control when heating is carried out.
3. Method of calculating cooling/heating capacity (max. capacity for combination with standard indoor unit)

   cooling / heating capacity = cooling / heating capacity obtained from performance characteristics table x each capacity rate of change

   In the case lenght of piping differs depending on the indoor unit, maximum capacity of aech unit during simultaneous operation is:

   cooling / heating capacity = cooling / heating capacity of each unit x capacity rate of change for each piping length

   <As for RXYMQ6MV4A - RXYSQ6M7V3B - RXYMQ6MVLT - RXYMQ6PV4A, RXMQ6PVE - RXMQ6VPE - RXYSQ6P7V3B - RXYSQ6P7Y1B - RXYSQ6PA7V1B - RXYSQPA7Y1B - RXYSQ6P8V1B - RXYSQ6P8Y1B>
4. When overall equivalent pipe length is 90m or more, the diameter of the main gas pipes (outdoor unit-branch sections) must be increased.
   [Diameter of above case]

Model	Gas	Liquid
RXYSQ6P8Y1B	ø 22.2	Not increased

5. When the main sections of the interunit gas pip diameters are increased the overall equivalent length should be calculated as follows.

   Overall equivalent length = Equivalent length to main pipe x 0,5 + Equivalent length after branching

   Example: RXYSQ6P8Y1B



   In the above case (Cooling)
   Overall equivalent length = 80m x 0.5 + 40m = 80m
   The correction factor in capacity when Hp = 0m is thus approximately 0.86

6. For RXYSQ: use these correction factors in case of vrv indoor unit.

5 Dimensional drawings

5 - 1 Dimensional Drawings

RXYSQ-P8Y1

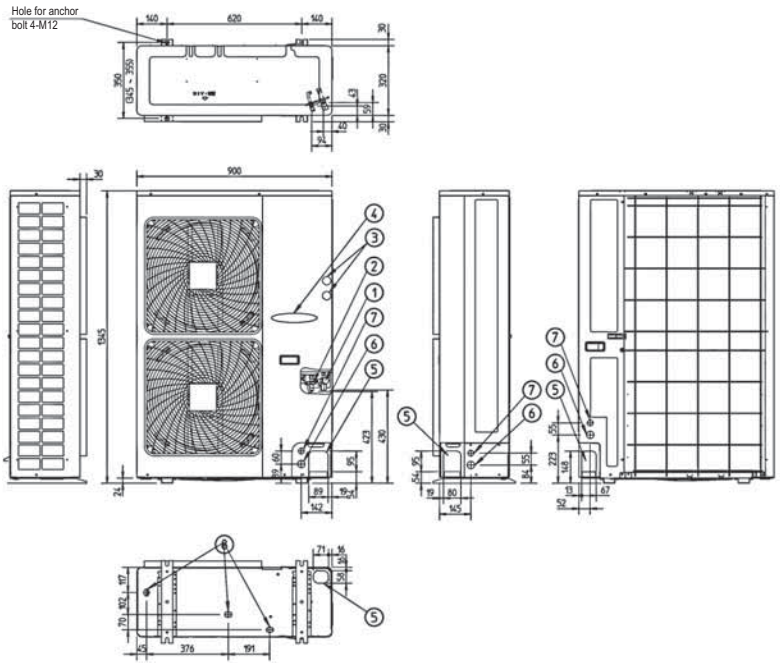

1	Gas pipe connection A
2	Liquid connection pipe Ø9.5 flare
3	Service port (in the unit) (2x)
4	Electronic connection and grounding terminal M5 (in switch box)
5	Refrigerant piping intake
6	Power supply wiring intake (knock hole Ø34)
7	Control wiring intake (knock hole Ø27)
8	Drain outlet

MODEL	A	
	With RA connection	With VRV correction
RXYSQ4P8Y1	Ø19.1 Brazing	Ø15.9 Flare
RXYSQ5P8Y1	Ø19.1 Brazing	Ø15.9 Flare
RXYSQ6P8Y1	Ø19.1 Brazing	Ø19.1 Brazing

3TW30374-1B

6 Centre of gravity

6 - 1 Centre of Gravity

RXYSQ-P8Y1

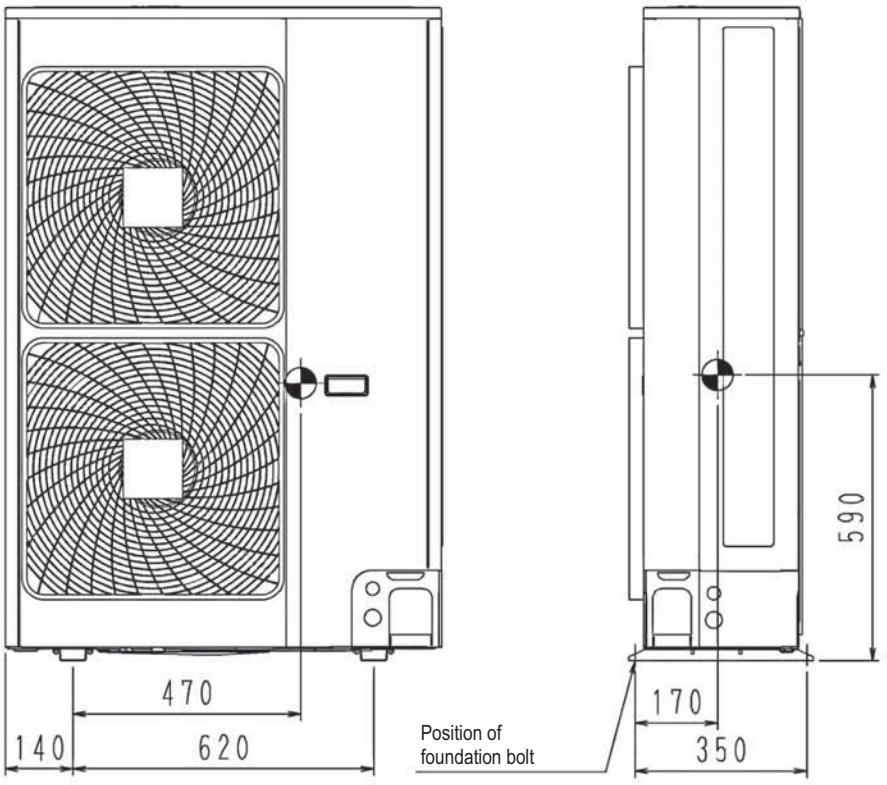

4D057918

7 Piping diagrams

7 - 1 Piping Diagrams

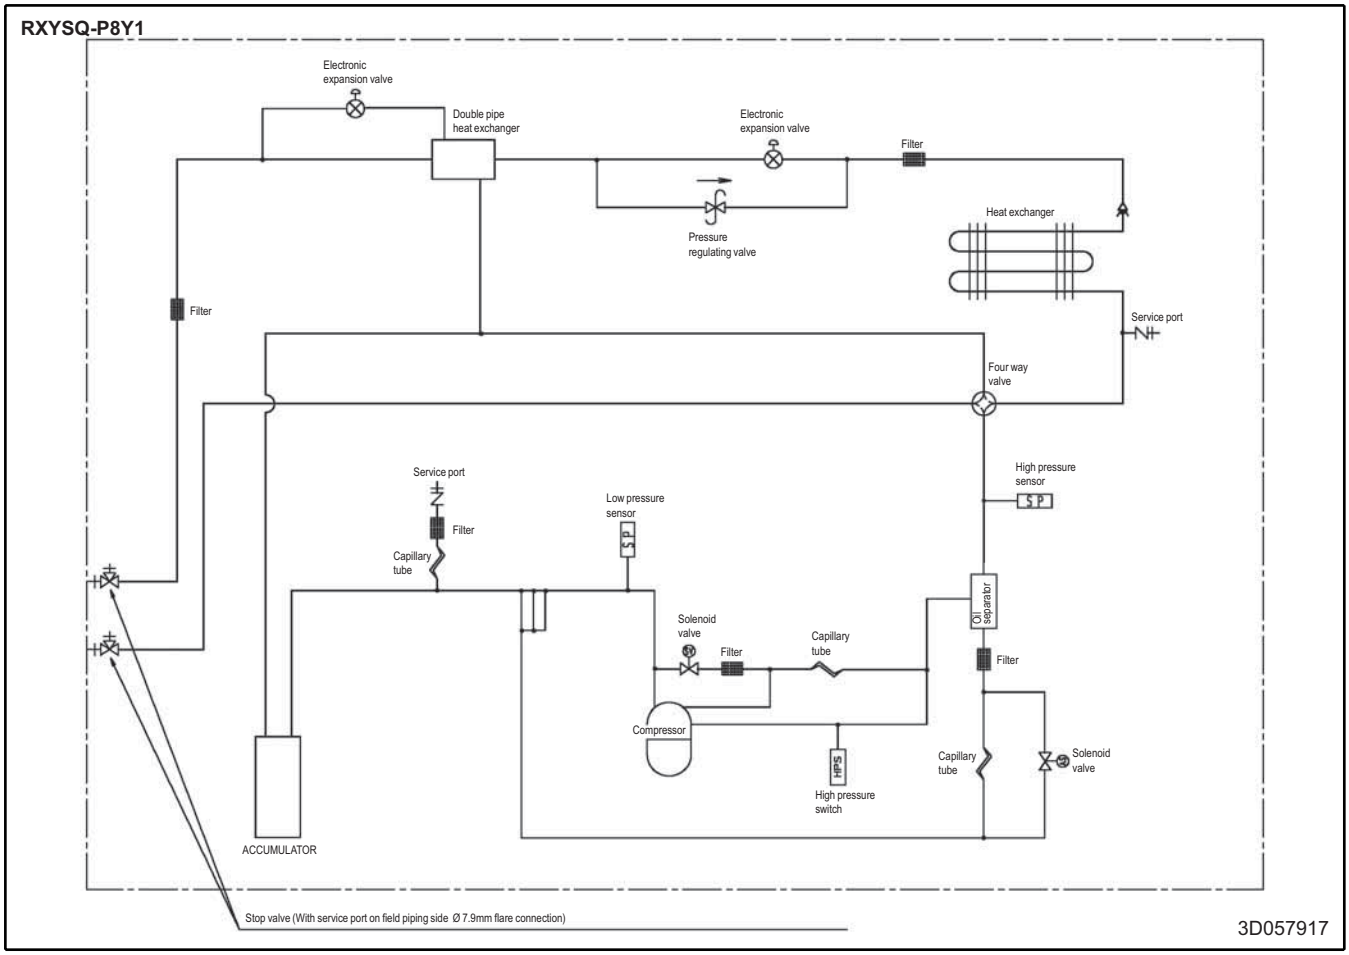

8 Wiring diagrams

8 - 1 Wiring Diagrams - Single Phase

RXYSQ-P8Y1

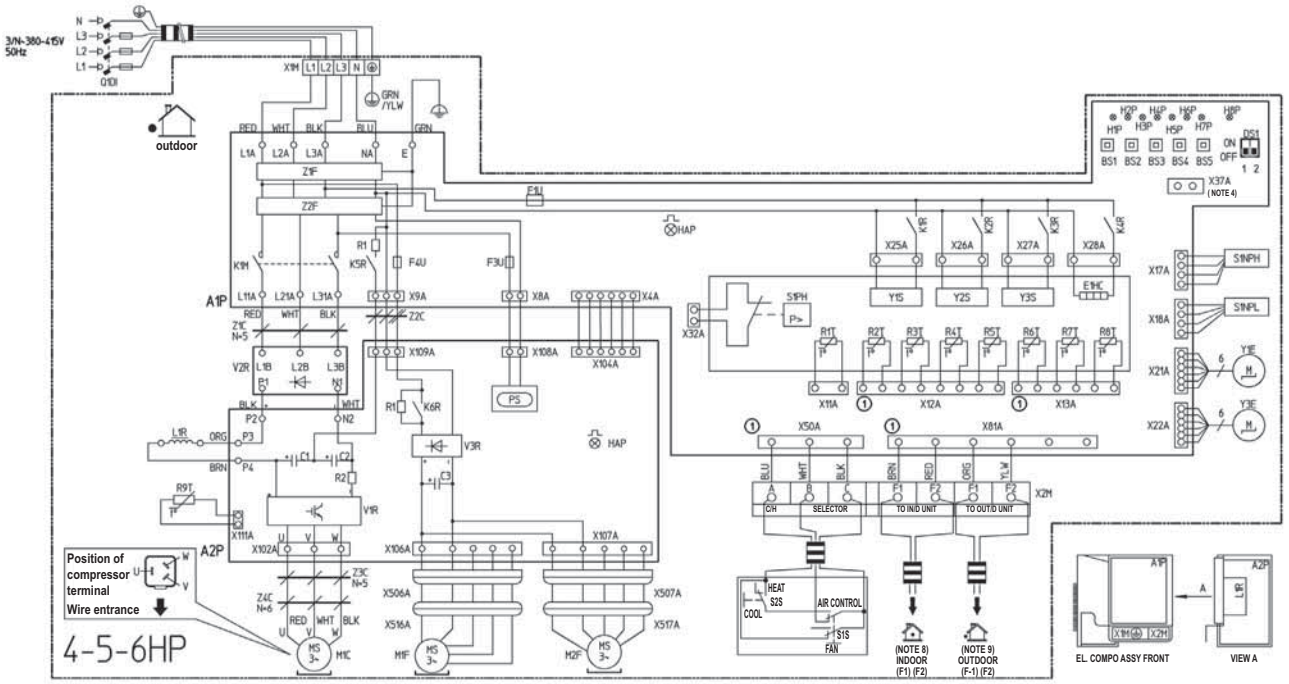

Cool/Heat selector				HAP (A2P)	Light emitting diode (service monitor green)	R5T	Thermistor (suction 2)
S1S	Selector switch (fan / cool - heat)			K1M(A1P)	Magnetic contactor	R6T	Thermistor (heat exchanger)
S2S	Selector switch (cool - heat)			K1R	Magnetic relay (Y1S)	R7T	Thermistor (liquid 1)
Connector of option adaptor				K2R	Magnetic relay (Y2S)	R8T	Thermistor (liquid 2)
X37A (note 4)	Connector (option adaptor power supply)			K3R	Magnetic relay (Y3S)	R9T	Thermistor (power module)
				K4R	Magnetic relay (E1HC)	S1NPH	Pressure sensor (high)
L1~RED	L2-WHT	L3-BLK	N-BLU	K5R, K6R	Magnetic relay	S1PNL	Pressure sensor (low)
A1P	Printed circuit board (main)			L1R	Reactor	S1PH	Pressure switch (high)
A2P	Printed circuit board (inv.)			M1C	Motor (compressor)	V1R	Power module
BS1~BS5	Pushbuttonswitch(mode,set,return,test,reset)			M1F	Motor (fan) (upper)	V2R, V3R	Diode module
C1~C3	Capacitor			M2F	Motor (fan) (lower)	X1M	Terminal strip (power supply)
DS1-1 DS1-2	Dip switch			PS	Switching power supply	X2M	Terminal strip (control) (C/H selector)
				Q1DI	Field earth leakage breaker (300mA)	Y1E	Electronic expansion valve (main)
E1HC	Crankcase heater			R1(A1P)	Resistor	Y3E	Electronic expansion valve (subcool)
F1, 3, 4U (A1P)	Fuse (T 6,3A / 250V)			R1(A2P) R2(A2P)	Resistor	Y1S	Solenoid valve (4 way valve)
						Y2S	Solenoid valve (hot gas)
H1P~H8P	Light emit. diode (serv. monitor-orange) [H2P] Prepare, test ---------- flickering Malfunction detection --- light up			R1T	Thermistor (air)	Y3S	Solenoid valve (U/L circuit)
				R2T	Thermistor (M1C discharge)	Z1C~Z4C	Noise filter (ferrite core)
				R3T	Thermistor (suction 1)	Z1F	Noise filter (with surge absorbed)
HAP (A1P)	Light emitting diode (service monitor green)			R4T	Thermistor (subcool)	Z2F	Noise filter

2TW29226-1B

NOTES

1. This wiring diagram only apllies to the outdoor unit.
2. L: Live, N: Neutral : Field wiring
3. : Terminal strip : Connector : Movable connector : Movable connector
   : Protective earth (screw) : Noiseless earth : Terminal
4. When using the option adapter, refer to the installation manual
5. Refer to the 'Installation or service manual' on how to use BS1 ~ BS5 push button switch and DS1-1, DS1-2 dip switch.
6. Do not operate the unit by short-circuiting protection device S1PH.
7. Colors: BLU = BLUE, BRN = BROWN, GRN = GREEN, RED = RED, WHT = WHITE, YLW = YELLOW, ORG = ORANGE, BLK = BLACK.
8. Refer to the installation manual for connection wiring to indoor - outdoor transmission F1-F2.
9. When using the central control system, connect outdoor-outdoor transmission F1-F2.

9 External connection diagrams

9 - 1 External Connection Diagrams

RXYSQ-P8Y1

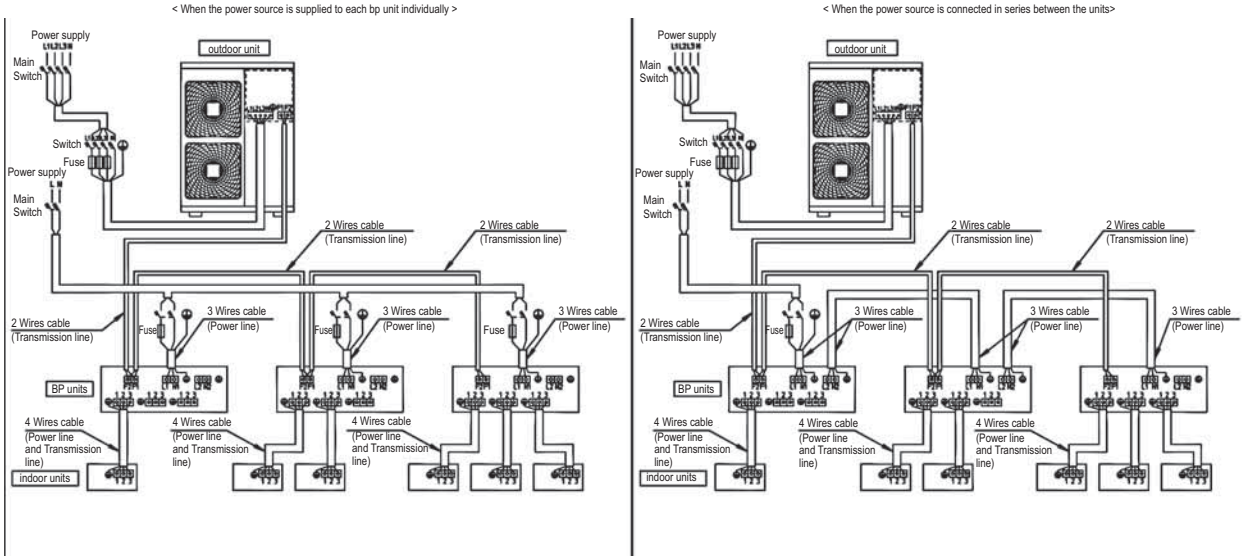

3TW33656-1

NOTES

1. All wiring, components and materials to be procured on the site must comply with the applicable local and national codes.
2. Use copper conductors only.
3. As for details, see wiring diagram.
4. Install circuit breaker for safety.
5. All field wiring and components must be provided by licensed electrician.
6. Unit shall be grounded in compliance with the applicable local and national codes.
7. Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
8. Be sure to install the switch and the fuse to the power line of each equipement.
9. Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing the multiple power sources.
10. If there exists the possibility of reversed phase, lose phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally. Running the product in reversed phase may break the compressor and other parts.

RXYSQ-P8Y1

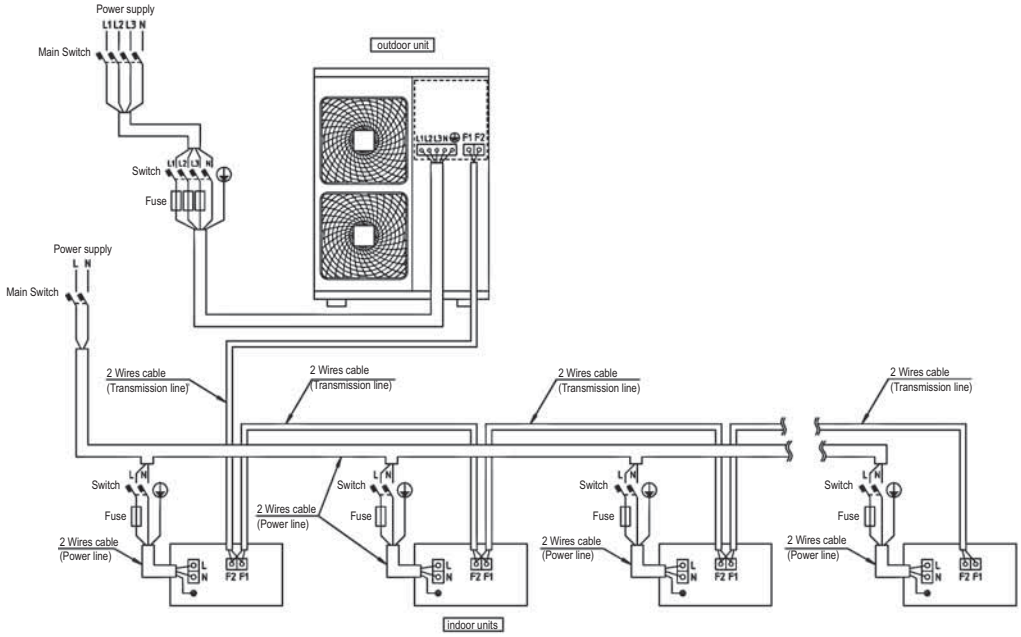

3TW33656-2

NOTES

1. All wiring, components and materials to be procured on the site must comply with the applicable local and national codes.
2. Use copper conductors only.
3. As for details, see wiring diagram.
4. Install circuit breaker for safety.
5. All field wiring and components must be provided by licensed electrician.
6. Unit shall be grounded in compliance with the applicable local and national codes.
7. Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
8. Be sure to install the switch and the fuse to the power line of each equipement.
9. Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing the multiple power sources.
10. If there exists the possibility of reversed phase, lose phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally. Running the product in reversed phase may break the compressor and other parts.

10 Sound data

10 - 1 Sound Power Spectrum

RXYSQ4P8Y1

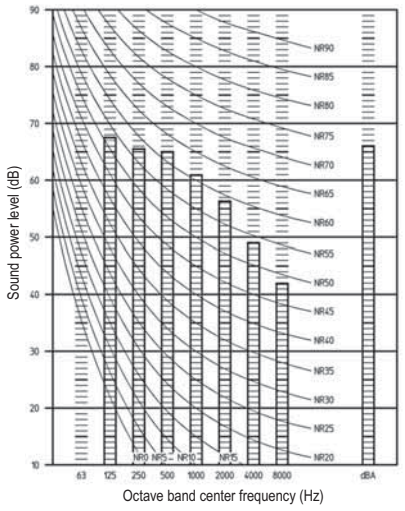

3TW29227-3

NOTES

1 dBA = A-weighted sound power level. (A-scale according to IEC)
2 Reference acoustic intensity 0dB = 10E-12W/m^2
3 Measured according to ISO 3744

RXYSQ5P8Y1

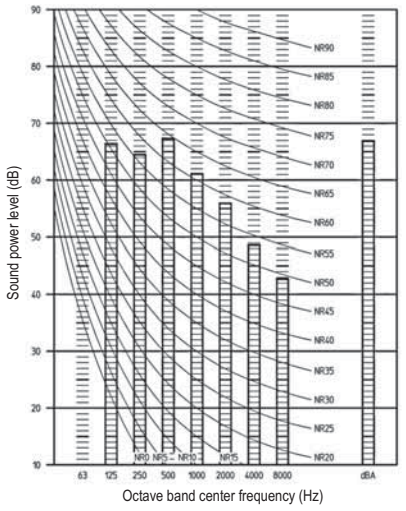

3TW29237-3

NOTES

1 dBA = A-weighted sound power level. (A-scale according to IEC)
2 Reference acoustic intensity 0dB = 10E-12W/m^2
3 Measured according to ISO 3744

RXYSQ6P8Y1

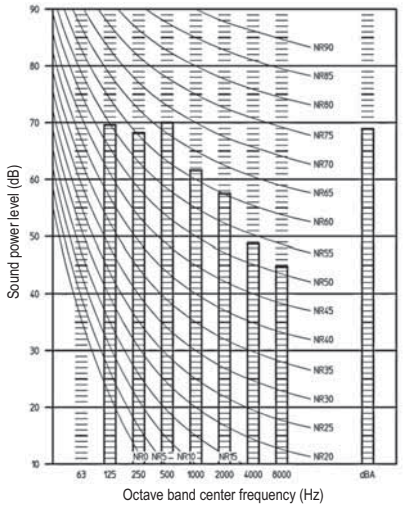

3TW29247-3

NOTES

1 dBA = A-weighted sound power level. (A-scale according to IEC)
2 Reference acoustic intensity 0dB = 10E-12W/m^2
3 Measured according to ISO 3744

10 Sound data

10 - 2 Sound Pressure Spectrum

RXYSQ4P8Y1

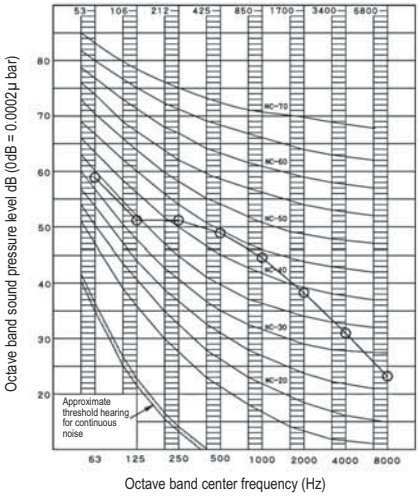

4D057920

NOTES

1 Over All (dB):
(B,G,N is already rectified)
2 Operating conditions:
Power source: 380-415V 50Hz
Cooling return air temperature: 27°C DB, 19°C WB
outdoor temperature: 35°C DB, 24°C WB
4 Measuring place: Anechoic chamber
5 The operating sound is measured in anechoic chamber,
if it is measured under the actual installation conditions,
it is normally over the set value due to enviromental noise and sound reflection.
6 Location of microphone.

Scale	50 Hz
A	50.0
C	62.0



RXYSQ4P8Y1

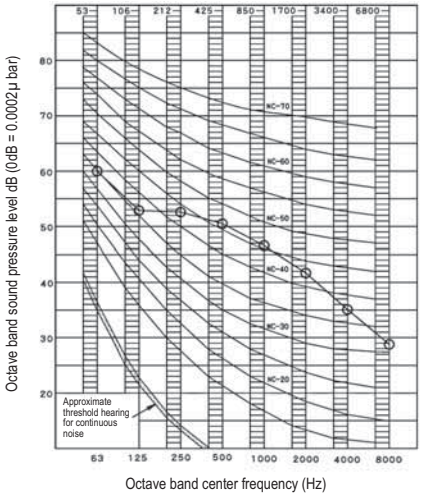

4D057923

NOTES

1 Over All (dB):
(B,G,N is already rectified)
2 Operating conditions:
Power source: 380-415V 50Hz
Heating return air temperature: 20°C DB
outdoor temperature: 7°C DB, 6°C WB
4 Measuring place: Anechoic chamber
5 The operating sound is measured in anechoic chamber,
if it is measured under the actual installation conditions,
it is normally over the set value due to enviromental noise and sound reflection.
6 Location of microphone.

Scale	50 Hz
A	52.0
C	63.5



RXYSQ5P8Y1

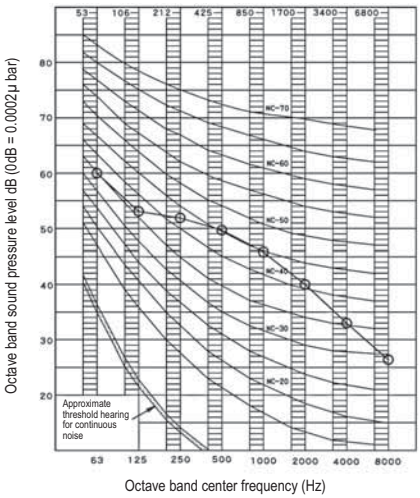

4D057921

NOTES

1 Over All (dB):
(B,G,N is already rectified)
2 Operating conditions:
Power source: 380-415V 50Hz
Cooling return air temperature: 27°C DB, 19°C WB
outdoor temperature: 35°C DB, 24°C WB
4 Measuring place: Anechoic chamber
5 The operating sound is measured in anechoic chamber,
if it is measured under the actual installation conditions,
it is normally over the set value due to enviromental noise and sound reflection.
6 Location of microphone.

Scale	50 Hz
A	51.0
C	63.5



RXYSQ5P8Y1

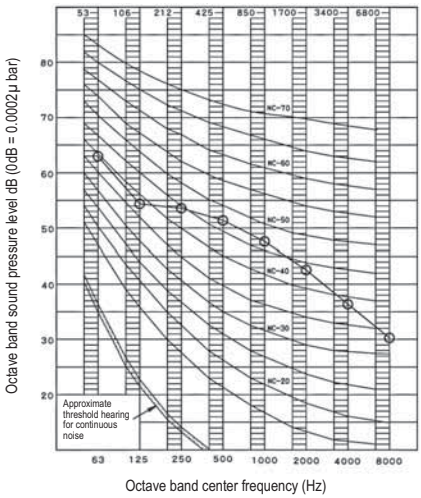

4D057924

NOTES

1 Over All (dB):
(B,G,N is already rectified)
2 Operating conditions:
Power source: 380-415V 50Hz
Heating return air temperature: 20°C DB
outdoor temperature: 7°C DB, 6°C WB
4 Measuring place: Anechoic chamber
5 The operating sound is measured in anechoic chamber,
if it is measured under the actual installation conditions,
it is normally over the set value due to enviromental noise and sound reflection.
6 Location of microphone.

Scale	50 Hz
A	53.0
C	65.3



10 Sound data

10 - 2 Sound Pressure Spectrum

RXYSQ6P8Y1

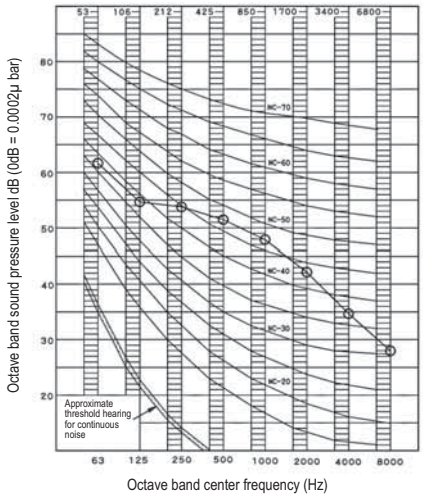

4D057922

NOTES

Scale	50 Hz
A	53.0
C	64.5

1 Over All (dB):
(B,G,N is already rectified)
2 Operating conditions:
Power source: 380-415V 50Hz
Cooling return air temperature: 27°C DB, 19°C WB
outdoor temperature: 35°C DB, 24°C WB
4 Measuring place: Anechoic chamber
5 The operating sound is measured in anechoic chamber,
if it is measured under the actual installation conditions,
it is normally over the set value due to enviromental noise and sound reflection.
6 Location of microphone.



RXYSQ6P8Y1

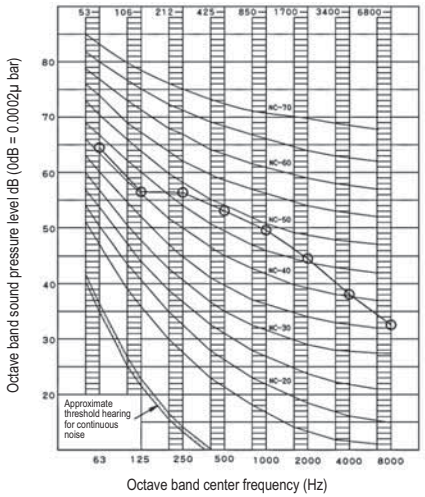

4D057925

NOTES

Scale	50 Hz
A	55.0
C	67.0

1 Over All (dB):
(B,G,N is already rectified)
2 Operating conditions:
Power source: 380-415V 50Hz
Heating return air temperature: 20°C DB
outdoor temperature: 7°C DB, 6°C WB
4 Measuring place: Anechoic chamber
5 The operating sound is measured in anechoic chamber,
if it is measured under the actual installation conditions,
it is normally over the set value due to enviromental noise and sound reflection.
6 Location of microphone.



11 Installation

11 - 1 Service Space

RXYSQ-P8Y1

Required installation space

(The unit of these values is 'mm')

1. Where there is an obstacle on the suction side:

(a) No obstacle above

(1) Stand-alone installation

• Obstacle on the suction side only



• Obstacle on both sides



(2) Series installation (2 or more)

• Obstacle on both sides



(b) Obstacle above, too

(1) Stand-alone installation

• Obstacle on the suction side, too



• Obstacle on the suction side and both sides



(2) Series installation (2 or more)

• Obstacle on the suction side and both sides



2. Where there is an obstacle on the discharge side:

(a) No obstacle above

(1) Stand-alone installation



(2) Series installation (2 or more)



(a) Obstacle above, too

(1) Stand-alone installation



(2) Series installation (2 or more)



3. Where there are obstacles on both suction and discharge sides:

Pattern 1

Where the obstacle on the discharge side is higher than the unit:

(There is no height limit for obstructions on the intake side)

(a) No obstacle above

(1) Stand-alone installation

L > H



(2) Series installation (2 or more)

L > H



(b) Obstacle above, too

(1) Stand-alone installation

The relations between H, A and L are as follows

	L	A
L ≤ H	0 < L ≤ 1/2 H	750
	1/2 H < L ≤ H	1000
H < L	Set the stand as: L ≤ H	

Close the bottom of the installation frame to prevent the discharged air from being bypassed.



(2) Series installation (2 or more)

The relations between H, A and L are as follows:

	L	A
L ≤ H	0 < L ≤ 1/2 H	1000
	1/2 H < L ≤ H	1250
H < L	Set the stand as: L ≤ H	

Close the bottom of the installation frame to prevent the discharged air from being bypassed.

Only two units can be installed for this series



Pattern 2

Where the obstacle on the discharge side is lower than the unit:

(There is no height limit for obstructions on the intake side)

(a) No obstacle above

(1) Stand-alone installation

L ≤ H



(2) Series installation (2 or more)

The relations between H, A and L are as follows

L	A
0 < L ≤ 1/2 H	250
1/2 H < L ≤ H	300



(b) Obstacle above, too

(1) Stand-alone installation

The relations between H, A and L are follows:

	L	A
L ≤ H	0 < L ≤ 1/2 H	100
	1/2 H < L ≤ H	200
H > L	Set the stand as: L ≤ H	

Close the bottom of the installation frame to prevent the discharged air from being bypassed.



(2) Series installation

The relations between H, A and L are as follows

	L	A
L ≤ H	0 < L ≤ 1/2 H	250
	1/2 H < L ≤ H	300
H < L	Set the stand as: L ≤ H Refer to the column of L ≤ H for A	

Close the bottom of the installation frame to prevent the discharged air from being bypassed.

Only two units can be installed for this series.



4. Double-decker installation

(a) Obstacle on the discharge side close the gap A (the gap between the upper and lower outdoor units) to prevent the discharged air from being bypassed.

Do not stack more than two units.

(b) Obstacle on the suction side close the gap A (the gap between the upper and lower outdoor units) to prevent the discharged air from being bypassed.

Do not stack more than two units.

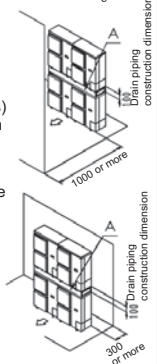

5. Multiple rows of series installation (on the rooftop, etc.)

(a) One row of stand-alone installation



(b) Rows of series installation (2 or more)

The relations between H, A and L are as follows

	L	A
L ≤ H	0 < L ≤ 1/2 H	250
	1/2 H < L ≤ H	300
H < L	Can not be installed	



3D045696D

11 Installation

11 - 2 Refrigerant Pipe Selection

RXYSQ-P8Y1

			Branch with refnet joint	Branch with refnet joint and refnet header	Branch with refnet header
Example of connection (Connection of 8 indoor units Heat pump system) ▯ indoor unit ◁ refnet joint ⬭ refnet header					
Maximum allowable length	Between outdoor and indoor units	Actual pipe length	Pipe length between outdoor and indoor units ≤150 m		
			[Example] unit 8: a+b+c+d+e+f+g+p ≤150 m	[Example] unit 6: a+b+h ≤ 150m, unit 8: a+i+k ≤150 m	[Example] unit 8: a+i ≤150 m
		Equivalent length	Equivalent pipe length between outdoor and indoor units ≤175 m (Assume equivalent pipe length of refnet joint to be 0.5 m and of the refnet header to be 1.0 m. (for calculation purposes))		
		Total extension length	Total piping length from outdoor unit to all indoor units between 10 m and 300 m		
Allowable height	Between outdoor and indoor units	Difference in height	Difference in height between outdoor and indoor units (H1) ≤50 m (≤40 m if outdoor unit is located in a lower position).		
	Between indoor and indoor units	Difference in height	Difference in height between adjacent indoor units (H2) ≤15 m		
Allowable length after the branch		Actual pipe length	Pipe length from first refrigerant branch kit (either refnet joint or refnet header) to indoor unit ≤40 m		
			[Example] unit 8: b+c+d+e+f+g+p ≤40 m	[Example] unit 6: b+h40 m, unit 8: i+k ≤40 m	[Example] unit 8: i ≤40 m

Refrigerant branch kit selection

Refrigerant branch kits can only be used with R410A.

Use the following refnet joint

Outdoor unit capacity type	Refrigerant branch kit name
RXYSQ4~6	KHRQ22M20T

Use the following refnet header

Outdoor unit capacity type	Refrigerant branch kit name
RXYSQ4~6	KHRQ22M29H

Pipe size selection

Caution on selecting connection pipes

If the overall equivalent piping length is ≥90 m, be sure to enlarge the pipe diameter of the gas-side main piping. If the recommended pipe size is not available, stick to the original pipe diameter (which may result in a small capacity decrease).

[Gas side]

RXYSQ4+5: → Ø15.9 Ø19.1

RXYSQ6: → Ø19.1 Ø22.2



1 Main pipe (enlarge)
2 First refrigerant branch kit
3 Indoor unit

A. Piping between outdoor unit and refrigerant branch kit

• Match to the size of the connection piping on the outdoor unit.

Outdoor unit connection piping size

Outdoor unit capacity type	Piping size (outer diameter x minimum thickness)	
	Gas pipe	Liquid pipe
RXYSQ4+5	Ø15.9x1.0 (Ø19.1x1.0)	Ø9.5x0.8
RXYSQ6	Ø19.1x1.0 (Ø22.2x1.0)	

B. Piping between refrigerant branch kits

• Use the pipe size from the following table.

Piping size (outer diameter x minimum thickness)	
Gas pipe	Liquid pipe
Ø15.9x1.0	Ø9.5x0.8

C. Piping between refrigerant branch kit and indoor unit

• Pipe size for direct connection to indoor unit must be the same as the connection size of indoor unit.

Indoor capacity index	Piping size (outer diameter x minimum thickness)	
	Gas pipe	Liquid pipe
20+25+32+40+50	Ø12.7x08	Ø6.4x0.8
63+80+100+125	Ø15.9x1.0	Ø9.5x0.8

How to calculate the additional refrigerant to be charged

Additional refrigerant to be charged R (kg)

R should be rounded o in units of 0.1 kg

$$R = \left(\text{Total length (m) of liquid piping size at Ø9.5}\right) \times 0.054 + \left(\text{Total length (m) of liquid piping size at Ø6.4}\right) \times 0.022$$

Example for refrigerant branch using refnet joint and refnet header

a: Ø9.5x3 m	d: Ø9.5x13 m	g: Ø6.4x10 m	j: Ø6.4x10 m
b: Ø9.5x10 m	e: Ø6.4x10 m	h: Ø6.4x20 m	k: Ø6.4x9 m
c: Ø9.5x10 m	f: Ø6.4x10 m	i: Ø9.5x10 m	

R=[73 x 0.054] + [69 x 0.022] = 5.46 ⇒ 5.5 kg

4PW66304-1

RXYSQ-P8Y1B

			Branch with refnet joint	Branch with refnet joint and refnet header	Branch with refnet header
Example of connection (Connection of 8 indoor units Heat pump system) ▯ indoor unit ◁ refnet joint ⬭ refnet header					
Maximum allowable length	Between outdoor and indoor units	Actual pipe length	Pipe length between outdoor and indoor units ≤150 m		
			[Example] unit 8: a+b+c+d+e+f+g+p ≤150 m	[Example] unit 6: a+b+h ≤ 150m, unit 8: a+i+k ≤150 m	[Example] unit 8: a+i ≤150 m
		Equivalent length	Equivalent pipe length between outdoor and indoor units ≤175 m (Assume equivalent pipe length of refnet joint to be 0.5 m and of the refnet header to be 1.0 m. (for calculation purposes))		
		Total extension length	Total piping length from outdoor unit to all indoor units between 10 m and 300 m		
Allowable height	Between outdoor and indoor units	Difference in height	Difference in height between outdoor and indoor units (H1) ≤50 m (≤40 m if outdoor unit is located in a lower position).		
	Between indoor and indoor units	Difference in height	Difference in height between adjacent indoor units (H2) ≤15 m		
Allowable length after the branch		Actual pipe length	Pipe length from first refrigerant branch kit (either refnet joint or refnet header) to indoor unit ≤40 m		
			[Example] unit 8: b+c+d+e+f+g+p ≤40 m	[Example] unit 6: b+h40 m, unit 8: i+k ≤40 m	[Example] unit 8: i ≤40 m

Refrigerant branch kit selection

Refrigerant branch kits can only be used with R410A.

Use the following refnet joint

Outdoor unit capacity type	Refrigerant branch kit name
RXYSQ4~6	KHRQ22M20T

Use the following refnet header

Outdoor unit capacity type	Refrigerant branch kit name
RXYSQ4~6	KHRQ22M29H

Pipe size selection

Caution on selecting connection pipes

If the overall equivalent piping length is ≥90 m, be sure to enlarge the pipe diameter of the gas-side main piping. If the recommended pipe size is not available, stick to the original pipe diameter (which may result in a small capacity decrease).

[Gas side]

RXYSQ4+5: → Ø15.9 Ø19.1

RXYSQ6: → Ø19.1 Ø22.2

1 Main pipe (enlarge)
2 First refrigerant branch kit
3 Indoor unit

A. Piping between outdoor unit and refrigerant branch kit

• Match to the size of the connection piping on the outdoor unit.

Outdoor unit connection piping size

Outdoor unit capacity type	Piping size (outer diameter x minimum thickness)	
	Gas pipe	Liquid pipe
RXYSQ4+5	Ø15.9x1.0 (Ø19.1x1.0)	Ø9.5x0.8
RXYSQ6	Ø19.1x1.0 (Ø22.2x1.0)	

B. Piping between refrigerant branch kits

• Use the pipe size from the following table.

Piping size (outer diameter x minimum thickness)	
Gas pipe	Liquid pipe
Ø15.9x1.0	Ø9.5x0.8

C. Piping between refrigerant branch kit and indoor unit

• Pipe size for direct connection to indoor unit must be the same as the connection size of indoor unit.

Indoor capacity index	Piping size (outer diameter x minimum thickness)	
	Gas pipe	Liquid pipe
20+25+32+40+50	Ø12.7x08	Ø6.4x0.8
63+80+100+125	Ø15.9x1.0	Ø9.5x0.8

How to calculate the additional refrigerant to be charged

Additional refrigerant to be charged R (kg)

R should be rounded o in units of 0.1 kg

$$R = \left(\text{Total length (m) of liquid piping size at Ø9.5}\right) \times 0.054 + \left(\text{Total length (m) of liquid piping size at Ø6.4}\right) \times 0.022$$

Example for refrigerant branch using refnet joint and refnet header

a: Ø9.5x3 m	d: Ø9.5x13 m	g: Ø6.4x10 m	j: Ø6.4x10 m
b: Ø9.5x10 m	e: Ø6.4x10 m	h: Ø6.4x20 m	k: Ø6.4x9 m
c: Ø9.5x10 m	f: Ø6.4x10 m	i: Ø9.5x10 m	

R=[73 x 0.054] + [69 x 0.022] = 5.46 ⇒ 5.5 kg

4PW66305-1

11 Installation

11 - 2 Refrigerant Pipe Selection

RXYSQ-P8Y1B

Example of connection
(Connection of 8 units heat pump system)

1 indoor unit
refrigerant branch kit (refnet joint)
BP 1 BP unit

NOTE The refrigerant branch kits must be positioned as close to the BP units as possible (c, d, e must be as short as possible).

Branch with refnet joint

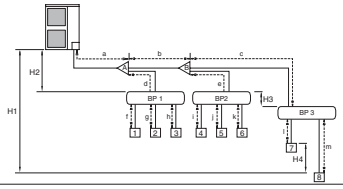

Maximum allowable length	Between outdoor and BP units	Total pipe length	Pipe length between outdoor and BP units ≤55 m [Example] 3 BP units: a+b+c+d+e≤55 m
	Between BP and indoor units	Total pipe length	Piping length between BP and indoor units: RXYSQ4≤60 m, RXYSQ5≤80 m, RXYSQ6≤90 m [Example] RXYSQ5: f+g+h+i+j+k+l+m≤80 m
	Between BP and an indoor unit	1 room length	Pipe length between BP and an indoor unit: ≤15 m [Example] f, g, h, i, j, k, l, m≤15 m
Minimum allowable length(*)	Between outdoor unit and the first refrigerant branch kit	Pipe length	Pipe length between outdoor unit and first refrigerant branch kit: ≥5 m [Example] a≥5 m
Allowable height	Between outdoor and indoor units	Difference in height	Difference in height between outdoor and indoor units (H1)≤30 m
	Between outdoor and BP units	Difference in height	Difference in height between outdoor and BP units (H2)≤30 m
	Between BP and BP units	Difference in height	Difference in height between BP and BP units (H3)≤15 m
	Between indoor and indoor units	Difference in height	Difference in height between indoor and indoor units (H4)≤15 m
Allowable length after the branch		Pipe length	Pipe length from first refrigerant branch kit (refnet joint) to indoor unit ≤40 m [Example] unit 8: b+c+m≤40 m [Example] unit 6: b+e+k≤40 m [Example] unit 3: d+h≤40 m
Refrigerant branch kit selection Refrigerant branch kits can only be used with R410A.			Use the following refnet joint: KHRQ22M20T.

(*) The refrigerant sound from the outdoor unit can be transmitted.

Pipe size selection

	Symbol		Piping size (outer diameter x minimum thickness) Gas pipe	Liquid pipe
Between outdoor and first refrigerant branch kit	a		Ø19.1x1.0	Ø9.5x0.8
Between refrigerant branch kit and refrigerant branch kit	b		Ø15.9x1.0	
		Total indoor capacity Q	**Gas pipe**	**Liquid pipe**
Between refrigerant branch kit and BP unit	c, d, e	Qc, Qd, Qe ≤5.0 kW	Ø12.7x0.8	Ø6.4x0.8
		Qc, Qd, Qe >5.0 kW	Ø15.9x1.0	Ø9.5x0.8

NOTE
- Qc, Qd, Qe is total connected indoor capacity.
- c, d, e indicates the symbols in the figure.

Example
Indoor 4: 2.5 kW
Indoor 5: 3.5 kW
Indoor 6: 5.0 kW
} Qe=11.0 kW
➡ (Gas pipe) Ø15.9x1.0 and (liquid pipe) Ø9.5x0.8

How to calculate the additional refrigerant to be charged
Additional refrigerant to be charged R (kg)
R should be rounded off in units of 0.1 kg

$$R = \left(\text{Total length (m) of liquid piping size at Ø9.5} \right) \times 0.054 + \left(\text{Total length (m) of liquid piping size at Ø6.4} \right) \times 0.022$$

Example for refrigerant branch using refnet joint

a: Ø9.5x10 m	d: Ø9.5x10 m	g: Ø6.4x10 m	j: Ø6.4x10 m	m: Ø6.4x8 m
b: Ø9.5x10 m	e: Ø9.5x10 m	h: Ø6.4x10 m	k: Ø6.4x5 m	
c: Ø6.4x10 m	f: Ø6.4x10 m	i: Ø6.4x10 m	l: Ø6.4x5 m	

R=[40 x 0.054] + [78 x 0.022] = 3.876 ⇒ 3.9 kg

4PW66305-1

12 Operation range

12 - 1 Operation Range

RXYSQ-P8Y1

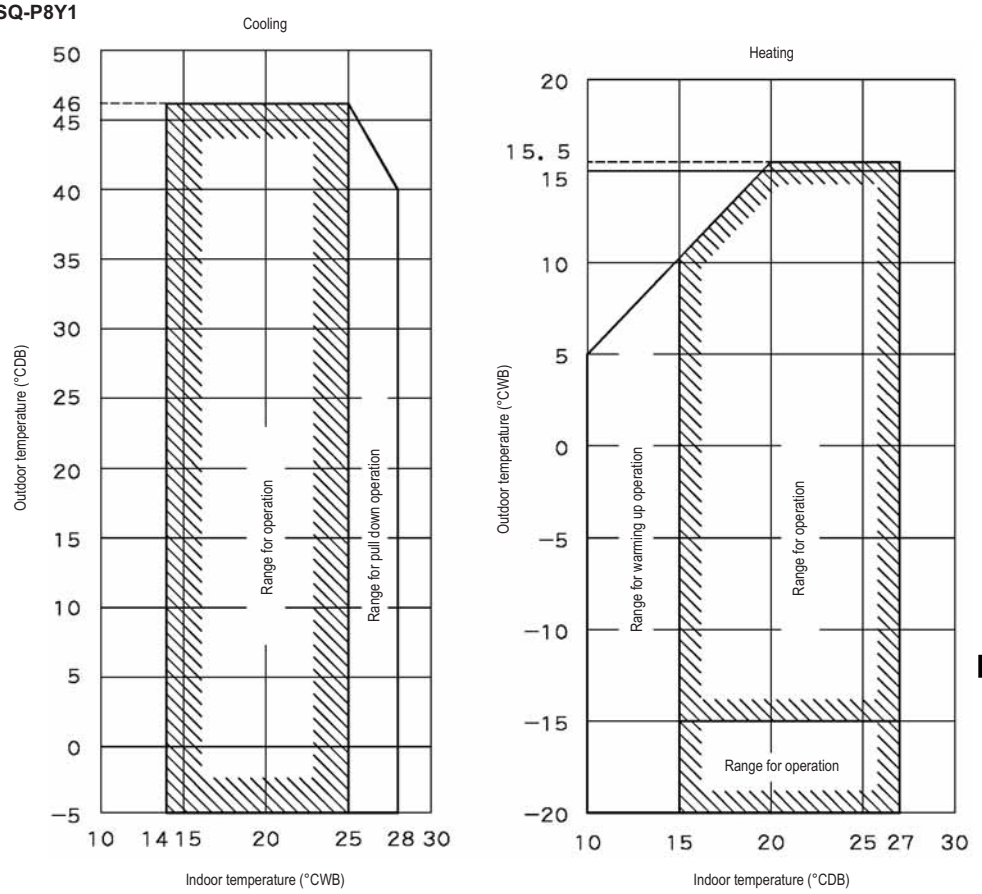

NOTE

These figures assume the following operating conditions.
Indoor and outdoor units:
- Equivalent pipe length: 7.5 m
- Level difference: 0 m

3D045713D

Daikin's unique position as a manufacturer of air conditioning equipment, compressors and refrigerants has led to its close involvement in environmental issues. For several years Daikin has had the intention to become a leader in the provision of products that have limited impact on the environment. This challenge demands the eco design and development of a wide range of products and an energy management system, resulting in energy conservation and a reduction of waste.

These products are not within the scope of the Eurovent certification program

Daikin Europe N.V. participates in the Eurovent Certification programme for Air conditioners (AC), Liquid Chilling Packages (LCP) and Fan coil units (FCU). Check ongoing validity of certificate online: www.eurovent-certification.com or using: www.certiflash.com"

The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.

BARCODE

Daikin products are distributed by:

DAIKIN EUROPE N.V. Naamloze Vennootschap - Zandvoordestraat 300, B-8400 Oostende - Belgium - www.daikin.eu - BE 0412 120 336 - RPR Oostende

EEDEN12-200 • 09/12 • Copyright Daikin
The present publication supersedes EEDEN11-200